

SCOPE OF WORK

Fire Suppression Upgrades Various Buildings

Woodbine Developmental Center
Woodbine, Cape May, N.J.


Project No. M1537-00

STATE OF NEW JERSEY

Honorable Philip D. Murphy, Governor
Honorable Sheila Y. Oliver, Lt. Governor

DEPARTMENT OF THE TREASURY

Elizabeth Maher Muoio, Treasurer

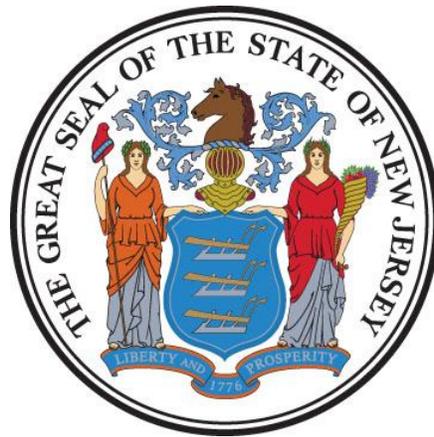

DIVISION OF PROPERTY MANAGEMENT AND CONSTRUCTION

Christopher Chianese, Director

Date: 02-13-2020

TABLE OF CONTENTS

SECTION	PAGE
I. OBJECTIVE	6
II. CONSULTANT QUALIFICATIONS	6
A. CONSULTANT & SUB-CONSULTANT PRE-QUALIFICATIONS.....	6
III. PROJECT BUDGET	6
A. CONSTRUCTION COST ESTIMATE (CCE)	6
B. CURRENT WORKING ESTIMATE (CWE)	7
C. CONSULTANT'S FEES	7
IV. PROJECT SCHEDULE	7
A. SCOPE OF WORK DESIGN & CONSTRUCTION SCHEDULE	7
B. CONSULTANT'S PROPOSED DESIGN & CONSTRUCTION SCHEDULE	8
C. CONSULTANT DESIGN SCHEDULE	8
D. BID DOCUMENT CONSTRUCTION SCHEDULE	9
E. CONTRACTOR CONSTRUCTION PROGRESS SCHEDULE	9
V. PROJECT SITE LOCATION & TEAM MEMBERS.....	10
A. PROJECT SITE ADDRESS	10
B. PROJECT TEAM MEMBER DIRECTORY	10
1. DPMC Representative:	10
2. Client Agency Representative:	10
VI. PROJECT DEFINITION	11
A. BACKGROUND	11
B. FUNCTIONAL DESCRIPTION OF THE BUILDING.....	11
1. Cottages 2, 3, and 4 / Long Term Care Units:	11
2. Cottage 10/ Long Term Care Unit:	11
3. General Services Building:	12
4. Administration Building:	12
5. Learning Center:	12
VII. CONSULTANT DESIGN RESPONSIBILITIES.....	12
A. INVESTIGATION PHASE	12
1. Fire Protection System Investigation:	12
2. Fire Protection Systems Investigation Report and Presentation:	13
B. EXISTING WATER SUPPLY:	13

C. NEW FIRE SUPPRESSION SYSTEM DESIGN CRITERIA	14
D. CENTER FOR MEDICARE & MEDICAID SERVICES (CMS) REQUIREMENTS	18
E. ADDITIONAL REQUIREMENTS	19
F. HAZARDOUS BUILDING MATERIALS	20
G. GENERAL DESIGN OVERVIEW	21
1. Design Detail:	21
2. Specification Format:	22
3. Submittal Schedule:	22
4. Construction Cost Estimates:	22
H. PROJECT COMMENCEMENT	23
1. Project Directory:	23
2. Site Access:	23
3. Project Coordination:	23
4. Existing Documentation:	24
5. Scope of Work:	24
6. Project Schedule:	25
I. BUILDING & SITE INFORMATION	25
1. Building Classification:	25
2. Building Block & Lot Number:	25
3. Building Site Plan:	25
4. Site Location Map:	25
J. DESIGN MEETINGS & PRESENTATIONS	26
1. Design Meetings:	26
2. Design Presentations:	26
K. CONSTRUCTION BID DOCUMENT SUBMITTAL	27
 VII. CONSULTANT CONSTRUCTION RESPONSIBILITIES	 27
A. GENERAL CONSTRUCTION ADMINISTRATION OVERVIEW	27
B. PRE-BID MEETING	27
C. POST BID REVIEW MEETING, RECOMMENDATION FOR AWARD	27
1. Post Bid Review:	28
2. Review Meeting:	28
3. Substitutions:	28
4. Schedule:	28
5. Performance:	29
6. Letter of Recommendation:	29
7. Conformed Drawings:	29
D. DIRECTOR'S HEARING	30
E. CONSTRUCTION JOB MEETINGS, SCHEDULES, LOGS	30
1. Meetings:	30
2. Schedules:	30
3. Submittal Log:	31
F. CONSTRUCTION SITE ADMINISTRATION SERVICES	31

G.	SUB-CONSULTANT PARTICIPATION.....	32
H.	DRAWINGS	32
1.	Shop Drawings:.....	32
2.	As-Built & Record Set Drawings:	32
I.	CONSTRUCTION DEFICIENCY LIST	33
J.	INSPECTIONS: SUBSTANTIAL & FINAL COMPLETION	33
K.	CLOSE-OUT DOCUMENTS	34
L.	CLOSE-OUT ACTIVITY TIME.....	34
M.	TESTING, TRAINING, MANUALS AND ATTIC STOCK	34
1.	Testing:	34
2.	Training:.....	34
3.	Operation & Maintenance Manuals:.....	35
4.	Attic Stock:	35
N.	CHANGE ORDERS	35
1.	Consultant:	36
2.	Contractor:	36
3.	Recommendation for Approval:	36
4.	Code Review:.....	36
5.	Cost Estimate:	37
6.	Time Extension:	37
7.	Submission:.....	37
8.	Meetings:.....	38
9.	Consultant Fee:	38
IX.	PERMITS & APPROVALS	38
A.	NJ UNIFORM CONSTRUCTION CODE PERMIT	38
1.	NJ Uniform Construction Code (NJUCC) Plan Review.....	38
2.	NJ Uniform Construction Code Permit.....	39
3.	Prior Approval Certification Letters:	39
4.	Multi-building or Multi-Site Permits:.....	40
5.	Special Inspections:	40
B.	OTHER REGULATORY AGENCY PERMITS, CERTIFICATES AND APPROVALS	40
C.	STATE INSURANCE APPROVAL	41
D.	PUBLIC EMPLOYEES OCCUPATIONAL SAFETY & HEALTH PROGRAM.....	41
E.	PERMIT MEETINGS.....	41
F.	MANDATORY NOTIFICATIONS	42
G.	CONSULTANT FEE.....	42
X.	GENERAL REQUIREMENTS	42
A.	SCOPE CHANGES	42
B.	ERRORS AND OMISSIONS.....	42
C.	ENERGY INCENTIVE PROGRAM	42

XI. ALLOWANCES 43

- A. PLAN REVIEW AND PERMIT FEE ALLOWANCE..... 43
- B. HAZARDOUS MATERIALS TESTING AND REPORT ALLOWANCE 44
- C. HAZARDOUS MATERIALS ABATEMENT DESIGN ALLOWANCE..... 44
- D. HAZARDOUS MATERIALS CONSTRUCTION ADMINISTRATION ALLOWANCE. 44
- E. WATER SUPPLY UPGRADE ALLOWANCE 45
- F. FIRE DETECTION SYSTEM UPGRADE ALLOWANCE 45

XII. SUBMITTAL REQUIREMENTS 45

- A. CONTRACT DELIVERABLES 45
- B. CATALOG CUTS 45
- C. PROJECT DOCUMENT BOOKLET 46
- D. DESIGN DOCUMENT CHANGES 46
- E. SINGLE-PRIME CONTRACT 46

XIII. SOW SIGNATURE APPROVAL SHEET 47

XIV. CONTRACT DELIVERABLES 48

XV. EXHIBITS..... 54

- A. SAMPLE PROJECT SCHEDULE FORMAT
- B. PROJECT SITE LOCATION MAP
- C. AERIAL VIEW OF BUILDINGS IN SOW
- D. PHOTOS
- E. WOODBINE DC’S RULES AND REGULATIONS

I. OBJECTIVE

The objective of the project is to install a new fully automated addressable type fire suppression system within the facility in the following buildings with the cottages as a priority:

The Learning Center, the Administration Building, the General Services Building, Cottages #2, #3, #4, and #10. The new Sprinkler system will tie into the existing fire alarm system. Institutional Type Sprinkler Heads to be installed. The sprinkler heads to be concealed wherever it is possible. The Consultant shall provide design and construction administration support services to complete the work.

II. CONSULTANT QUALIFICATIONS

A. CONSULTANT & SUB-CONSULTANT PRE-QUALIFICATIONS

The Consultant shall be a firm pre-qualified with the Division of Property Management & Construction (DPMC) in the following discipline(s):

- **P001 Architecture**

The Consultant shall also have in-house capabilities or Sub-Consultants pre-qualified with DPMC in:

- **P002 Electrical Engineering**
- **P005 Civil Engineering**
- **P010 Fire Protection Engineering**
- **P025 Estimating/Cost Analysis**
- **P037 Asbestos Design**
- **P038 Asbestos Safety Control Monitoring**
- **P065 Lead Paint Evaluation/ Inspection**

As well as, **any and all** other Architectural, Engineering and Specialty Disciplines necessary to complete the project as described in this Scope of Work (SOW).

III. PROJECT BUDGET

A. CONSTRUCTION COST ESTIMATE (CCE)

The initial Construction Cost Estimate (CCE) for this project is \$ 2,693,999

The Consultant shall review this Scope of Work and provide a narrative evaluation and analysis of the accuracy of the proposed project CCE in their technical proposal based on their professional experience and opinion.

B. CURRENT WORKING ESTIMATE (CWE)

The Current Working Estimate (CWE) for this project is \$ 3,861,000.

The CWE includes the construction cost estimate and all consulting, permitting and administrative fees.

The CWE is the Client Agency’s financial budget based on this project Scope of Work and shall not be exceeded during the design and construction phases of the project unless DPMC approves the change in Scope of Work through a Contract amendment.

C. CONSULTANT’S FEES

The construction cost estimate for this project *shall not* be used as a basis for the Consultant’s design and construction administration fees. The Consultant’s fees shall be based on the information contained in this Scope of Work document and the observations made and/or the additional information received during the pre-proposal meeting.

IV. PROJECT SCHEDULE

A. SCOPE OF WORK DESIGN & CONSTRUCTION SCHEDULE

The following schedule identifies the estimated design and construction phases for this project and the estimated durations.

PROJECT PHASE	ESTIMATED DURATION (Calendar Days)
1. Site Access Approvals & Schedule Design Kick-off Meeting	14
2. Investigation Phase	42
• <i>Project Team & DPMC Plan/Code Unit Review & Comment</i>	14
3. Design Development Phase 50% (Minimum)	42
• <i>Project Team & DPMC Plan/Code Unit Review & Comment</i>	14
4. Final Design Phase 100%	42
• <i>Project Team & DPMC Plan/Code Unit Review & Approval</i>	14

5. Final Design Re-Submission to Address Comments	7
• <i>Project Team & DPMC Plan/Code Unit Review & Approval</i>	14
6. DCA Health Care Plan Review	20
• <i>Project Team & DPMC Plan/Code Unit Review & Approval</i>	14
7. Permit Application Phase	7
• <i>Issue Plan Release</i>	
8. Bid Phase	42
9. Award Phase	28
10. Construction Phase	210

B. CONSULTANT’S PROPOSED DESIGN & CONSTRUCTION SCHEDULE

The Consultant shall submit a project design and construction bar chart schedule with their technical proposal that is similar in format and detail to the schedule depicted in **Exhibit ‘A’**. The bar chart schedule developed by the Consultant shall reflect their recommended project phases, phase activities, activity durations.

The Consultant shall estimate the duration of the project Close-Out Phase based on the anticipated time required to complete each deliverable identified in Section XIV of this document entitled “Contract Deliverables - Project Close-Out Phase” and include this information in the bar chart schedule submitted.

A written narrative shall also be included with the technical proposal explaining the schedule submitted and the reasons why and how it can be completed in the time frame proposed by the Consultant.

This schedule and narrative will be reviewed by the Consultant Selection Committee as part of the evaluation process and will be assigned a score commensurate with clarity and comprehensiveness of the submission.

C. CONSULTANT DESIGN SCHEDULE

Based on the Notice to Proceed, Consultant shall update their approved schedule and shall distribute it at the design kickoff meeting. Note that this schedule shall be submitted in both paper format and on compact disk in a format compatible with *Microsoft Project*. This schedule will be binding for the Consultant’s activities and will include the start and completion dates for

each design activity. The Consultant and Project Team members shall use this schedule to ensure that all design milestone dates are being met for the project. The Consultant shall update the schedule to reflect performance periodically (minimally at each design phase) for the Project Team review and approval. Any recommendations for deviations from the approved design schedule must be explained in detail as to the causes for the deviation(s) and impact to the schedule.

D. BID DOCUMENT CONSTRUCTION SCHEDULE

The Consultant shall include a construction schedule in Division 1 of the specification bid document. This schedule shall contain, at minimum, the major activities and their durations for each trade specified for the project. This schedule shall be in “bar chart” format and will be used by the Contractors as an aid in determining their bid price. It shall reflect special sequencing or phased construction requirements including, but not limited to: special hours for building access, weather restrictions, imposed constraints caused by Client Agency program schedules, security needs, lead times for materials and equipment, anticipated delivery dates for critical items, utility interruption and shut-down constraints, and concurrent construction activities of other projects at the site and any other item identified by the Consultant during the design phases of the project.

E. CONTRACTOR CONSTRUCTION PROGRESS SCHEDULE

The Contractor shall be responsible for preparing a coordinated combined progress schedule with the Sub-Contractors after the award of the contract. This schedule shall meet all of the requirements identified in the Consultant’s construction schedule. The construction schedule shall be completed in accordance with the latest edition of the Instructions to Bidders and General Conditions and Bulletins that may be issued on the project.

The Consultant must review and analyze this progress schedule and recommend approval/disapproval to the Project Team until a satisfactory version is approved by the Project Team. The Project Team must approve the baseline schedule prior to the start of construction and prior to the Contractor submitting invoices for payment.

The Consultant shall note in Division 1 of the specification that the State will not accept the progress schedule until it meets the project contract requirements and any delays to the start of the construction work will be against the Contractor until the date of acceptance by the State.

The construction progress schedule shall be reviewed, approved, and updated by the Contractor, Consultant, and Project Team members at each regularly scheduled construction job meeting and the Consultant shall note the date and trade(s) responsible for project delays (as applicable).

V. PROJECT SITE LOCATION & TEAM MEMBERS

A. PROJECT SITE ADDRESS

The location of the project site is:

Woodbine Developmental Center
1175 DeHirsch Avenue
Woodbine, Cape May County, New Jersey 08270

See **Exhibit 'B'** for the project site location map.

B. PROJECT TEAM MEMBER DIRECTORY

The following are the names, addresses, and phone numbers of the Project Team members.

1. DPMC Representative:

Name: Richard Herrero, Project Manager
Address: Division Property Management & Construction
20 West State Street, 3rd Floor
Trenton, NJ 08608-1206
Phone No: (609)292-6558
E-Mail No: Richard.Herrero@treas.nj.gov

2. Client Agency Representative:

Name: Tadeusz Wardencki, Project Manager
Address: Department of Human Services
222 South Warren Street, PO Box 700
Trenton, New Jersey 08625
Phone No: (609) 777-2084
E-Mail No: Tadeusz.Wardencki@dhs.state.nj.us

VI. PROJECT DEFINITION

A. BACKGROUND

Woodbine Developmental Center was founded in 1921, is located on 250 acres of land in Cape May County. The Woodbine Developmental Center provides residential treatment and rehabilitation services to developmentally disabled men who reside in 18 residential buildings.

In addition to the residential cottages and the food services building, the Center contains forty additional buildings that include a medical building, administrative offices, school, recreational facilities, a powerhouse, maintenance facilities and various support facilities. The facility was constructed in 1930 and continues to utilize some of the original buildings. Additional buildings have been constructed and numerous renovations have occurred over the years to maintain compliance with codes and licensing requirements.

The Client Agency desires to install a new fire suppression system in the following seven Buildings: Cottages 2, 3, 4 10, General Services Building, Administration Building and the Learning Center Building. This project will include the design and installation of new fire suppression system throughout these buildings.

B. FUNCTIONAL DESCRIPTION OF THE BUILDING

Please note that all buildings shall be occupied throughout construction.

1. Cottages 2, 3, and 4:

Cottages 2, 3, and 4 are located to the south of the Clothing Center along Marine Drive. Each of the cottages is a one (1) story wood frame building, approximately 8,000 square feet each, with brick exterior and a basement. Trenching will be required to get Fire Water into the basement. The current designation, for the buildings listed (DCA), are non-life hazard usage, B-use group. The buildings were at one time listed as Long Term Care Units. The buildings are currently used as support buildings and utilized for Consumer/Client program areas.

2. Cottage 10:

Cottage 10 is located adjacent to the Maintenance Building on Bay Drive, and is separated by a parking area. The cottage is a one (1) story wood frame building, approximately 7,000 square feet, with brick exterior and a partially above grade full basement. Trenching will be required to get Fire Water into the basement.

3. General Services Building:

The General Services Building is a two (2)-story structure, approximately 4,000 square feet. The building has a partial basement and a crawl space.

The crawl space is the location the domestic waterline comes into the partial basement. Trenching will be required to get Fire Water into the crawl space/ basement.

4. Administration Building:

The Administration Building is a one (1) story structure, approximately 21,000 square feet. The building consists of 3 wings off of a main central area and a basement.

The basement houses a partial fire suppression system in the Storage areas of the Administration Building as per CMS (Centers for Medicare and Medicaid Services) regulations.

5. Learning Center:

The Learning Center building is a one (1) story structure with a slab on grade foundation. The building is approximately 47,000 square feet. There is an existing partial fire suppression system, with sprinkler valves covering the stage area.

VII. CONSULTANT DESIGN RESPONSIBILITIES

A. INVESTIGATION PHASE

1. Fire Protection System Investigation:

Investigate the existing fire protection systems in the seven buildings listed above to identify those areas that will require fire protection systems and related components. This information shall also be used to identify the areas of the building that will be impacted by the fire protection construction work and potential removal of hazardous materials. Prior to the start of the design phase of the project, the Consultant shall conduct a survey of the existing facility fire detection system to ensure that it will be compatible with the new fire suppression system. Verify that the fire alarm panels have adequate capacity and zones for the new fire suppression system components. Document the location of the fire alarm panels, zone detectors, sensors, wiring & raceways, and all equipment and systems that are monitored by the panels.

Items to investigate shall include, but not be limited to, the fire suppression water supply system, fire alarm panel, fire detection system devices and operation, wiring, ceiling impact, hazardous materials survey, and cost estimates.

2. Fire Protection Systems Investigation Report and Presentation:

Provide three (3) bound copies of the Fire Protection Systems Investigation Report to the Project Manager. The document shall be presented in an 8 ½” x 11” bound booklet that contains a Table of Contents describing all of the information contained in the document and an Executive Summary with a list of recommendations.

An oral presentation shall be made to the Project Team describing the findings of the investigation conducted and the recommendations for upgrade or replacement. The Consultant may not proceed with the design phase of the project until the Project Team has reviewed the report and approved the recommendations made for this project.

All supporting documentation such as calculations, photographs, drawings, catalog cuts, correspondence, meeting minutes, and any other data obtained shall be included in the report appendix for reference.

All cost data shall be in sufficient detail for each related division of the latest CSI format and shall also be summarized on the DPMC 38 Cost Analysis form(s).

B. EXISTING WATER SUPPLY:

Survey the existing water supply system of the facility to determine if the capacity is adequate for the new fire suppression system.

1. Hydrant Tests:

The Consultant and/or a pre-qualified Testing Lab shall conduct field tests of the nearest fire hydrants and determine the static and residual pressures and flow rates of water being supplied to the buildings. Schedule the fire hydrant testing such that representatives of the Client Agency, DPMC Code Plan Review Unit, the local fire department, the local municipal water company and the DCA code inspector may witness the test. All costs associated with the hydrant tests shall be estimated by the Consultant and the amount included in the base bid of their fee proposal.

2. Hydraulic Calculations:

The hydrant test results shall be used as the basis for hydraulic calculations to verify that there is adequate water pressure volume and flow for the building sprinkler systems. Signed and sealed calculations must be submitted to the DPMC Plan & Code Review Unit for record, review and approval. The Consultant shall estimate the costs associated with the potential requirement to upgrade the building water supply system and enter that amount in their fee proposal line item entitled **“Water Supply Upgrade Allowance”**.

3. Water Supply System Upgrade Design Criteria:

The potential water supply design shall include all upgrades to the existing water delivery system required to meet codes for a fully suppressed building. Provide details on the drawings and information for all new water supply components such as: pumps and control systems, water supply lines, gate valves, water meters and pits, line flushing valves, line flushing procedure, fire hydrants, restraints, valve boxes, manholes, permit requirements, etc. Size any new water supply line to provide suppression for the remaining portion of the buildings.

4. Water Supply Upgrade Allowance:

If the underground water supply line must be replaced or upgraded or a new waterline needs to be installed, the Consultant shall show the dimensioned location and elevation of the new water line and all existing underground utility lines in that construction area. This information will eliminate the potential of the lines intersecting at critical crossing points. Drawings shall show the path of the new water line from the existing water main and shall indicate the size and length.

Details showing the location and method of the potential new water line tie-in to the main lines shall be shown on the drawings including the new water meter and meter pits if required. The line shall have individual water line shut off valves and detector double check backflow preventer device. Identify how the main water line will be restrained from movement on the plans with details such as thrust blocks, tie rods or mechanical joints. Include all tests, procedures, and disinfection requirements for the water line. Provide construction administration services during all phases of the water line installation

Pipe trenching size details, bedding, backfill materials, and dewatering requirements shall be identified on the drawings. Include all site restoration work needed including lawn areas, sidewalks and driveways. If roadway repaving is required, provide exact details of paving depths and construction materials and methods that comply with DOT standards.

All design coordination and submissions, meetings, permits and approval requirements with the local utility companies must be determined and provided by the Consultant.

The Consultant shall estimate the costs associated with the potential requirement to upgrade the building water supply systems and enter that amount in their fee proposal line item entitled **“Water Supply Upgrade Allowance”**.

C. NEW FIRE SUPPRESSION SYSTEM DESIGN CRITERIA

1. Existing Conditions:

Survey the interior of the buildings and show all existing spaces, ceiling construction, location of walls and partitions, and the occupancy of each room on the drawings. Identify the location of

all equipment located above the ceilings to determine the appropriate routing of the new sprinkler mains, branches, and head locations. Provide a design to relocate any existing equipment necessary to install the new sprinkler system such as conduit, piping, ductwork, suspended ceiling system components, panels, light fixtures, mechanical equipment, etc. If hazardous materials are detected during the survey the consultant shall refer to section VII F. for detailed removal and disposal direction.

2. Design Documents:

A fully engineered and code approved design of the new sprinkler system shall be provided by the Consultant. The design shall include, but not be limited to a scaled layout of the new sprinkler piping and all related system components. The system layout shall be shown on the current interior floor plan of the building and coordinated with the ceilings, lighting, HVAC ductwork and diffusers, wiring conduit, and other obstructions. Identify the location of all walls, partitions, concealed spaces, closets, and bathroom areas. The design shall be in accordance with NFPA 13 (2013) and the International Building Code (IBC). The Consultant shall provide the design in accordance to NFPA 101 and NFPA 99 standards for a Healthcare Facility.

Provide fire protection for all material storage areas and identify the storage commodity description and classification, storage area height, and storage arrangement.

All new sprinkler heads shall be an “institutional” type head, concealed if possible and shall be approved by the Client Agency/Project Team. Heads shall be anti-ligature in design.

Design documents and specifications shall indicate the type of system and the name of the desired manufacturer and two alternate manufacturers of each type of equipment proposed including but not limited to: pipe material, size and wall thickness, and center to center dimension of the sprinkler heads, control valves, check valves, backflow preventers, line flushing valves, drain pipes, air compressors, jockey pumps, fire pumps, and test connections, etc. Details of the hanger type and location, sleeves, braces, and methods of securing the sprinkler system shall be provided including calculations that indicate they meet all support and seismic requirements.

A statement shall be included in the specifications and on the drawings that states: “If the sprinkler Contractor prepares shop drawings that differ in design from those supplied by the Consultant, they shall submit them, **through the consultant**, to DPMC Plan & Code Review Unit for approval prior to fabrication and installation of the system”.

3. Alarms/Monitoring/Control:

All valves which control the flow of water to water based fire suppression systems shall be provided with tamper alarm switches.

Provide each sprinkler system and/or zone with a water flow alarm switch.

As applicable, all non-addressable alarm initiating, supervisory and status monitored devices shall be integrated into the building fire alarm system.

4. Fire Detection System Integration:

The new sprinkler system, sprinkler main valve supervision, flow and tamper switches must be integrated with any upgraded fire detection system in the building and must comply with both NFPA 13 and NFPA 72.

5. Fire Detection System Upgrade Allowance:

Depending upon recommendations in the Investigation Phase, if necessary, upgrade or replace the existing fire alarm panel, annunciator panel(s) and any other related components of the fire detection system based on capacity, compatibility with the new fire suppression system, age, and condition. The Consultant shall estimate the potential costs for the design and construction administration services necessary to upgrade the existing fire detection system and include that amount in their fee proposal line item entitled **“Fire Detection Upgrade Allowance.”**

6. Sprinkler System Valves & Drains:

Provide all system wet and dry valves, compressors, and Siamese connections per the requirements of NFPA 13. All hydrants, control valves, check valves, backflow preventers, line flushing valves, drain pipes, air compressors, jockey pumps, fire pumps, and test connections shall be shown.

Each system shall have a single control valve designed to shut off both the domestic and sprinkler systems and a separate valve for the domestic system only. The sprinkler system main valve supervision, flow and tamper switches must be integrated with the fire detection system of the building and must comply with NFPA 72 current code.

Design all test valves and drains as needed. As applicable, dry systems must be designed to completely drain after testing without special procedures and no low spots will be allowed in the piping. It is preferred that all drains shall discharge to the exterior of the building.

Where required by the Insurance Underwriter or Client Agency, provide durable locks and chains for each interior valve controlling water to a sprinkler or standpipe system and each outside valve controlling fire water into the building or on the site, so that these valves may be locked in the fully open position.

All control, drain, and test connection valves shall be provided with permanently marked weather proof metal or rigid plastic identification signs attached with corrosion resistant materials.

7. Pipe Penetration:

All new piping installed in the buildings shall be sealed where it passes through the floors and walls of the structure and the material must afford the required fire rating of that floor and wall. Details of the pipe penetrations shall be included on the design drawings indicating the type of penetration, how they will be sealed and the type of material to be used.

8. Sprinkler Riser Diagram:

A sprinkler piping riser diagram shall be provided identifying the routing and interface of the new system piping to the existing or upgraded water supply line and related components. The drawings shall provide a full height cross section of the area where the sprinkler system is being installed including the ceiling construction and location of any structural obstructions. Drawings shall include all standard fire safety symbols and occupancy of each area or room.

9. Building Interior Finishes:

The design documents shall address the restoration of all building interior finishes that are impacted by the installation of the fire suppression system component items such as the sprinkler pipe, attachment devices, heads, soffits, ceiling tiles, etc.

Finishes shall include, but not be limited to patching, painting, and the relocation of lighting, signage, alarms, ventilators, louvers, curtain tracts, wood trim, ceiling systems, etc. necessary to install the sprinkler pipe, attachment devices, heads and all other components of the system.

Procedures required to control and eliminate odors related to paint, cleaning agents, etc. must be addressed in the design documents to prevent potential problems with the building occupants. Materials with minimal odors and fumes should be specified.

10. Seismic Design:

Design shall conform to all seismic design requirements for the construction site locations.

11. Riser Main Drain Connection:

Each fire suppression pipe riser shall have its own main drain connection. This connection will be run "full open" for two minutes to measure flow and pressure of the system during the annual

test. Gauge connections shall also be provided. The discharge point of these drains shall be at a location that will not cause damage to the building.

12. Sprinkler System Controls:

Sprinkler system controls shall be vertically mounted and accessible without the need for a ladder. Service side and system side pressure gauges shall be provided installed and legible from a standing position

13. System Operation:

The existing fire detection system must remain operational during the installation of new system components and the installation of the new fire suppression system.

14. Sanitation:

Sanitation requirements such as flushing of the lines, chemical treatments, and pipe cleaning details shall be included in the design documents for all piping components. Readily removable fittings shall be provided at the end of all cross mains to facilitate the flushing process.

15. Equipment Tests:

Upon completion of the project, and prior to issuance of the Certificate of Approval, the Contractor shall test the complete fire suppression and detection system making adjustments as required to secure all necessary approvals. The Consultant shall identify the testing requirements in the specifications including the hydrostatic test pressures, the test duration under pressure, and the amount of allowable leakage per hour.

All equipment testing shall be conducted in the presence of the Consultant and designated representatives of the DPMC, Client Agency, Contractors and DCA. The Consultant shall be responsible for the coordination and scheduling of all tests. All test results shall be collected and bound in a manual for reference.

Locate test/drain connections so that their discharge will not cause damage to the building or site. Provide splash blocks where test and drain connections are discharged to grade. All test stations shall be located in areas where testing does not affect occupants or programs, and water discharge does not pool or freeze.

D. CENTER FOR MEDICARE & MEDICAID SERVICES (CMS) REQUIREMENTS

The Center for Medicare & Medicaid Services (CMS) “Life Safety” chapter requires that all accredited organizations keep their Life Safety Code drawings current. Design documents and as-builts are required to display the following information:

- A legend that clearly identifies features of fire safety (for example, fire extinguishers, exit signs)
- Areas of the building that are fully sprinklered (if the building is partially sprinklered)
- Locations of all hazardous storage areas
- Locations of all fire-rated barriers
- Locations of all smoke barriers
- Suite boundaries, including the sizes of the identified suites-both sleeping (maximum 5,000 square feet) and nonsleeping (maximum 10,000 square feet) suites.
- Locations of designated smoke compartments
- Locations of chutes and shafts
- Any approved equivalencies or waivers
- Provide a Life Safety Drawing for the Learning Center, the Administration Building, the General Services Building, and Cottages #2, #3, #4, and #10.

E. ADDITIONAL REQUIREMENTS

The following miscellaneous general requirements shall apply to this project.

1. **Contractor’s Use of the Premises:** The Contractor’s use of the premises shall be as indicated in Exhibit “C”, **Security Procedures**, attached at the end of this scope. Any additional use requirements shall be reviewed and approved by the Using Agency.
2. **Demolition Material:** Describe the approved storage methods of all demolition materials, location of dumpsters, protection of dumpsters, removal requirements and security issues in the design documents. If components of the existing systems are not to be reused, they shall be removed in their entirety and legally disposed. **No components shall be “abandoned in place”.**
3. **Equipment Protection at the Construction Site:** Provide a detailed drawing which depicts the approved method of protecting the furniture, carpeting, interior finishes, and other classroom equipment during the installation of the sprinkler system. Procedures for the security of materials and equipment in the facility must be established and included in the specification. Approved methods of dust control and cleaning the construction site after each workday must be described in the design documents.
4. **Working Hours:** Working hours shall be as determined by the facility staff. Consultant and Contractors are advised that due to the nature of this Facility, shift work and/or phased construction may be required. All costs related to site meetings, project

inspections, regularly scheduled job meetings, etc., shall be included in the Consultant's base bid.

- 5. Equipment Spare Parts List:** A spare parts list shall be prepared and items purchased, including a storage cabinet with keyed lock, as part of this project for all critical items necessary for the successful operation of the fire detection and suppression systems.
- 6. Equipment Training:** Coordinate the training of the new fire detection and suppression systems with Using Agency personnel and equipment vendors. Manuals shall be issued that contains the operating procedures, parts list, detailed drawings, catalog cuts, and maintenance procedures for all equipment installed in the building. The content of the manuals and training sessions, and the length of the training sessions shall be reviewed and approved by the DPMC Project Team members prior to the training seminar.
- 7. Special Security and Safety Design Requirements:** The design and installation of the new sprinkler pipe, heads, flow test equipment, pull stations, smoke detectors and all other components must address security, tamper resistance, damage, and anti-ligature prevention issues, provided that these issues are identified as applicable to the project requirements during the investigation phase of the design. The Consultant must coordinate these issues with representatives of the Client Agency to determine what is currently accepted in the facility. Design layouts of the actual sprinkler head and/or piping will be reviewed with these issues as priorities.

F. HAZARDOUS BUILDING MATERIALS

Consultant shall survey the building(s) and, if deemed necessary, collect samples of materials that will be impacted by the construction/demolition activities and analyze them for the presence of hazardous materials including:

1. Asbestos in accordance with N.J.A.C. 5:23-8, Asbestos Hazard Abatement Sub code.
2. Lead in accordance with N.J.A.C. 5:17, Lead Hazard Evaluation and Abatement Code.
3. PCB's in accordance with 40 CFR 761, Polychlorinated Biphenyls (PCBs) Manufacturing, Processing, Distribution in Commerce, and Use Prohibitions. Consultant shall engage a firm certified in the testing and analysis of materials containing PCB's.

The Consultant shall engage the services of a Sub-Consultant, pre-qualified with DPMC in the P065 Lead Paint Evaluation/Inspection Specialty Discipline to produce a design document that stipulates construction safety procedures that adhere to applicable Federal and State regulations and that shall be incorporated into the project design documents.

A formal lead abatement shall not be conducted. Rather, the design document shall deal only with proposed lead base paint as may be encountered in areas of the building that will be affected by the construction of this project. It is intended that the construction Contractor for the project shall be responsible for any and all air or swab sampling during construction as may be required by law. The Sub-Consultant shall supervise said activity and sampling.

Consultant shall document their procedure, process and findings and prepare a “Hazardous Materials Survey Report” identifying building components impacted by construction activities requiring hazardous materials abatement. Consultant shall provide three copies of the “Hazardous Materials Survey Report” to the Project Manager.

Consultant shall estimate the cost of hazardous materials sample collection, testing, analysis and preparation of the Hazardous Materials Survey Report and include that amount in their fee proposal line item entitled “**Hazardous Materials Testing and Report Allowance**”, refer to paragraph XI.B.

Based on the Hazardous Materials Survey Report, Consultant shall provide construction documents for abatement of the hazardous materials impacted by the work in accordance with the applicable code, sub code and Federal regulations.

Consultant shall estimate the cost to prepare construction documents for hazardous materials abatement and include that amount in their fee proposal line item entitled “**Hazardous Materials Abatement Design Allowance**”, refer to paragraph XI.C.

Consultant shall estimate the cost to provide “Construction Monitoring and Administration Services” for hazardous materials abatement activities and include that amount in their fee proposal line item entitled “**Hazardous Materials Construction Administration Allowance**”, refer to paragraph XI.D.

There shall be no “mark-up” of sub-consultant or subcontractor fees if sub-consultants or subcontractors are engaged to perform any of the work defined in paragraph VII.F “Hazardous Building Materials”. All costs associated with managing, coordinating, observing and administrating sub-consultants and subcontractors performing hazardous materials sampling, testing, analysis, report preparation, hazardous materials construction administration services shall be included in the consultant’s lump sum fee proposal.

G. GENERAL DESIGN OVERVIEW

1. Design Detail:

Section VII of this Scope of Work is intended as a guide for the Consultant to understand the overall basic design requirements of the project and is not intended to identify each specific design component related to code and construction items. The Consultant shall provide those details

during the design phase of the project ensuring that they are in compliance with all applicable codes, regulating authorities, and the guidelines established in the DPMC Procedures for Architects and Engineers Manual.

The Consultant shall understand that construction documents submitted to DPMC shall go beyond the basic requirements set forth by the current copy of the Uniform Construction Code N.J.A.C. 5:23-2.15(f). Drawings and specifications shall provide detail beyond that required to merely show the nature and character of the work to be performed. The construction documents shall provide sufficient information and detail to illustrate, describe and clearly delineate the design intent of the Consultant and enable all Contractors to uniformly bid the project.

The Consultant shall review and comply with the DPMC “Plan Review Instructions” which can be found on DPMC’s web site at:

http://www.state.nj.us/treasury/dpmc/lists_and_publications.shtml

The Consultant shall ensure that all of the design items described in this scope of work are addressed and included in the project drawings and specification sections where appropriate.

It shall be the Consultant’s responsibility to provide all of the design elements for this project. Under no circumstance may they delegate the responsibility of the design; or portions thereof, to the Contractor unless specifically allowed in this Scope of Work.

2. Specification Format:

The Consultant shall prepare the construction specifications in the Construction Specifications Institute (CSI) format entitled Master Format©, latest edition.

The project construction specifications shall include only those CSI Master Format© specification sections and divisions applicable to this specific project.

3. Submittal Schedule:

The Consultant shall include a submittal schedule in Division 1 of the specifications. The schedule (list of required submittals) shall identify the general conditions and/or specification section (number and name) and the type of submittal required (material data, product data, test results, calculations, etc.). The submittal schedule is a compilation of the submittals required on the project and is provided as an aid to the contractor.

4. Construction Cost Estimates:

The Consultant shall include with each design submittal phase identified in Paragraph IV.A, including the Permit Application Phase and Bid Phase, a detailed construction cost estimate

itemized and summarized by the divisions and sections of the Construction Specification Institute (CSI) Master Format© latest edition applicable to the project.

The detailed breakdown of each work item shall include labor, equipment, material and total costs.

The construction estimate shall include all alternate bid items and all unit price items itemized and summarized by the divisions and sections of the specifications.

All cost estimates shall be adjusted for regional location, site factors, construction phasing, premium time, building use group, location of work within the building, temporary swing space, security issues, and inflation factors based on the year in which the work is to be performed.

The cost estimate shall include descriptions of all allowances and contingencies noted in the estimate.

All cost estimates must be submitted on a DPMC-38 Project Cost Analysis form at each design phase of the project supported by the detailed construction cost estimate. The Project Manager will provide cost figures for those items which may be in addition to the CCE such as art inclusion, CM services, etc. and must be included as part of the CWE. This cost analysis must be submitted for all projects regardless of the Construction Cost Estimate amount.

H. PROJECT COMMENCEMENT

A pre-design meeting shall be scheduled with the Consultant and the Project Team members at the commencement of the project to obtain and/or coordinate the following information:

1. Project Directory:

Develop a project directory that identifies the name and phone number of key designated representatives who may be contacted during the design and construction phases of this project.

2. Site Access:

Develop procedures to access the project site and provide the names and phone numbers of approved escorts when needed. Obtain copies of special security and policy procedures that must be followed during all work conducted at the facility and include this information in Division 1 of the specification.

3. Project Coordination:

Review and become familiar with any current and/or future projects at the site that may impact the design, construction, and scheduling requirements of this project. Incorporate all appropriate information and coordination requirements in Division 1 of the specification.

4. Existing Documentation:

Copies of the following documents will be provided to each Consulting firm at the pre-proposal meeting to assist in the bidding process.

- M408-01 Roof Replacement Admin. Building WDC, dated 07-11-1983, prepared by Architects Chartered.
- M1155-00 As Built Drawings Roof Retrofit WDC Learning Center, dated 12-29-1997, prepared by Radey & Fuller Architects & Engineers.
- M1186-00 Asbestos Abatement & Incinerator Removal WDC Cottage 10, dated 03-04-1996, prepared by GA Environmental Services, INC.
- M1298-00 Fire Sprinkler System WDC Cottages, dated 12-18-2000, prepared by Joseph Stong INC. and Fire Suppression Retrofit WDC Various Buildings, dated 06-21-2000, prepared by Rolf Jensen and Associates, INC.
- M1383-00 As Built Drawings Roof & Mechanical Replacement WDC Administration Building, dated 02-09-2012, Prepared by Gannett Fleming, INC.
- M1468-00: As Built Drawings Roof & HVAC Replacement WDC Learning Center, dated 09-03-2014, Prepared by ARMM Associates, INC.

Review these documents and any additional information that may be provided at a later date such as reports, studies, surveys, equipment manuals, as-built drawings, etc. The State does not attest to the accuracy of the information provided and accepts no responsibility for the consequences of errors by the use of any information and material contained in the documentation provided. It shall be the responsibility of the Consultant to verify the contents and assume full responsibility for any determination or conclusion drawn from the material used. If the information provided is insufficient, the Consultant shall take the appropriate actions necessary to obtain the additional information required.

All original documentation shall be returned to the provider at the completion of the project.

5. Scope of Work:

Review the design and construction administration responsibilities and the submission requirements identified in this Scope of Work with the Project Team members. Items such as: contract deliverables, special sequencing or phased construction requirements, special hours for construction based on Client Agency programs or building occupancy, security needs, delivery dates of critical and long lead items, utility interruptions or shut down constraints for tie-ins, weather restrictions, and coordination with other project construction activities at the site shall be addressed.

This information and all general administrative information; including a narrative summary of the work for this project, *shall be included in Division 1* of the specification. The Consultant shall assure that there are no conflicts between the information contained in Division 1 of the specification and the DPMC General Conditions.

6. Project Schedule:

Review and update the project design and construction schedule with the Project Team members.

I. BUILDING & SITE INFORMATION

The following information shall be included in the project design documents.

1. Building Classification:

Provide the building Use Group Classification and Construction Type on the appropriate design drawing.

2. Building Block & Lot Number:

Provide the site Block and Lot Number on the appropriate design drawing.

3. Building Site Plan:

Only when the project scope involves site work, or when the design triggers code issues that require site information to show code compliance, shall a site plan be provided that is drawn in accordance with an accurate boundary line survey. The site plan shall include, but not be limited to, the following as may be applicable:

- The size and location of new and existing buildings and additions as well as other structures.
- The distance between buildings and structures and to lot lines.
- Established and new site grades and contours as well as building finished floor elevations.
- New and existing site utilities, site vehicular and pedestrian roads, walkways and parking areas.

4. Site Location Map:

Provide a site location map on the drawing cover sheet that identifies the vehicular travel routes from major roadways to the project construction site and the approved access roads to the Contractor's worksite staging area.

J. DESIGN MEETINGS & PRESENTATIONS

1. Design Meetings:

Conduct the appropriate number of review meetings with the Project Team members during each design phase of the project so they may determine if the project meets their requirements, question any aspect of the contract deliverables, and make changes where appropriate. The Consultant shall describe the philosophy and process used in the development of the design criteria and the various alternatives considered to meet the project objectives. Selected studies, sketches, cost estimates, schedules, and other relevant information shall be presented to support the design solutions proposed. Special considerations shall also be addressed such as: Contractor site access limitations, utility shutdowns and switchover coordination, phased construction and schedule requirements, security restrictions, available swing space, material and equipment delivery dates, etc.

It shall also be the responsibility of the Consultant to arrange and require all critical Sub-Consultants to be in attendance at the design review meetings.

Record the minutes of each design meeting and distribute within seven (7) calendar days to all attendees and those persons specified to be on the distribution list by the Project Manager.

2. Design Presentations:

The minimum number of design presentations required for each phase of this project is identified below for reference:

Investigation Phase:

One (1) oral presentation at Woodbine Development Center at phase completion.

Design Development Phase:

One (1) working meeting onsite.

One (1) oral presentation at Woodbine Development Center at phase completion.

Final Design Phase:

One (1) working meeting onsite.

One (1) oral presentation at Woodbine Development Center at phase completion.

K. CONSTRUCTION BID DOCUMENT SUBMITTAL

In addition to submitting construction bid documents as defined in Section XIV Contract Deliverables, Consultant shall submit both specifications and drawings on compact disk (CD) in *Adobe Portable Document Format (.pdf)*.

VIII. CONSULTANT CONSTRUCTION RESPONSIBILITIES

A. GENERAL CONSTRUCTION ADMINISTRATION OVERVIEW

This section of the Scope of Work is intended as a guide for the Consultant to understand their overall basic construction administration responsibilities for the project and does not attempt to identify each specific activity or deliverable required during this phase. The Consultant shall obtain that information from the current publication of the DPMC Procedures for Architects and Engineers Manual and any additional information provided during the Consultant Selection Process.

B. PRE-BID MEETING

The Consultant shall attend, chair, record and distribute minutes of the Contractor pre-bid meetings. When bidders ask questions that may affect the bid price of the project, the Consultant shall develop a Bulletin(s) to clarify the bid documents in the format described in the Procedures for Architects and Engineers Manual, Section 9.2 entitled "Bulletins." These Bulletins must be sent to DPMC at least seven (7) calendar days prior to the bid opening date. DPMC will then distribute the document to all bidders.

C. POST BID REVIEW MEETING, RECOMMENDATION FOR AWARD

The Consultant; in conjunction with the Project Manager, shall review the bid proposals submitted by the various Contractors to determine the low responsible bid for the project. The Consultant; in conjunction with the Project Manager and Project Team members, shall develop a post bid questionnaire based on the requirements below and schedule a post bid review meeting with the Contractor's representative to review the construction costs and schedule, staffing, and other pertinent information to ensure they understand the Scope of the Work and that their bid proposal is complete and inclusive of all requirements necessary to deliver the project in strict accordance with the plans and specifications.

1. Post Bid Review:

Review the project bid proposals including the alternates, unit prices, and allowances within seven (7) calendar days from the bid due date. Provide a bid tabulation matrix comparing all bids submitted and make a statement about the high, low, and average bids received. Include a comparison of the submitted bids to the approved current construction cost estimate. When applicable, provide an analysis with supporting data, detailing why the bids did not meet the construction cost estimate.

2. Review Meeting:

Arrange a meeting with the apparent low bid Contractor to discuss their bid proposal and other issues regarding the award of the contract. Remind the Contractor that this is a Lump Sum bid. Request the Contractor to confirm that their bid proposal does not contain errors. Review and confirm Alternate pricing and Unit pricing and document acceptance or rejection as appropriate.

Comment on all omissions, qualifications and unsolicited statements appearing in the proposals. Review any special circumstances of the project. Ensure the Contractor's signature appears on all post bid review documents.

3. Substitutions:

Inquire about any potential substitutions being contemplated by the Contractor and advise them of the State's guidelines for the approval of substitutions and the documentation required. Review the deadline and advise the Contractor that partial submissions are not acceptable. Submission after the deadline may be rejected by the State.

Equal substitutions that are proposed by the Contractor that are of lesser value must have a credit change order attached with the submittal (See Article 4.7.5 "Substitutions" of the General Conditions). The State has the right to reject the submission if there is no agreement on the proposed credit. Contractor will be responsible to submit a specified item.

4. Schedule:

Confirm that the Contractor is aware of the number of calendar days listed in the contract documents for the project duration and that the Contractor's bid includes compliance with the schedule duration and completion dates. Particular attention shall be given to special working conditions, long lead items and projected delivery dates, etc. Review project milestones (if applicable). This could give an indication of Contractor performance, but not allow a rejection of the bid.

Review the submittal timeframes per the Contract documents. Ask the Contractor to identify what products will take over twenty-eight (28) calendar days to deliver from the point of submittal approval.

If a CPM Schedule is required, review the provisions and have Contractor acknowledge the responsibility. Ask for the name of the CPM Scheduler and the “ballpark” costs.

5. Performance:

Investigate the past performance of Contractor by contacting Architects and owners (generally three of each) that were listed in their DPMC pre-qualification package or other references that may have been provided. Inquire how the Contractor performed with workmanship, schedule, project management, change orders, cooperation, paper work, etc.

6. Letter of Recommendation:

The Consultant shall prepare a Letter of Recommendation for contract award to the Contractor submitting the lowest responsible bid within three (3) calendar days from the post bid review meeting. The document shall contain the project title, DPMC project number, bid due date and expiration date of the proposal. It shall include a detailed narrative describing each post bid meeting agenda item identified above and a recommendation to award the contract to the apparent low bid Contractor based on the information obtained during that meeting. Describe any acceptance or rejection of Alternate pricing and Unit pricing.

Comment on any discussion with the Contractor that provides a sense of their understanding of the project and any special difficulties that they see, and how they might approach those problems.

Attach all minutes of the Post bid meeting and any other relevant correspondence with the Letter of Recommendation and submit them to the Project Manager.

7. Conformed Drawings:

The Consultant shall prepare and distribute two (2) sets of drawings stamped “Conformed Drawings” to the Project Manager that reflect all Bulletins and/or required changes, additions, and deletions to the pertinent drawings within fourteen (14) calendar days of the construction contract award date.

Any changes made in Bulletins, meeting minutes, post bid review requirements shall also be reflected in the specification.

D. DIRECTOR’S HEARING

The Consultant must attend any Director’s hearing(s) if a Contractor submits a bid protest. The Consultant shall be present to interpret the intent of the design documents and answer any technical questions that may result from the meeting. In cases where the bid protest is upheld, the Consultant shall submit a new “Letter of Recommendation” for contract award. The hours required to attend the potential hearings and to document the findings shall be estimated by the Consultant and the costs will be included in the base bid of their fee proposal.

E. CONSTRUCTION JOB MEETINGS, SCHEDULES, LOGS

The Consultant shall conduct all of the construction job meetings, to be held bi-weekly for the duration of construction, in accordance with the procedures identified in the A/E manual and those listed below.

1. Meetings:

The Consultant and Sub-Consultant(s) shall attend the pre-construction meeting and all construction job meetings during the construction phase of the project. The Consultant shall chair the meeting, transcribe and distribute the job-meeting minutes for every job meeting to all attendees and to those persons specified to be on the distribution list by the Project Manager. The Agenda for the meeting shall include, but not be limited to the items identified in the Procedures for Architects and Engineers Manual, Section 10.3.1, entitled “Agenda.”

Also, the Consultant is responsible for the preparation and distribution of minutes within three (3) calendar days of the meeting. The format to be used for the minutes shall comply with those identified in the “Procedures for Architects and Engineers Manual,” Section 10.3.4, entitled, “Format of Minutes.” All meeting minutes are to have an “action” column indicating the party that is responsible for the action indicated and a deadline to accomplish the assigned task. These tasks must be reviewed at each job progress meeting until it is completed and the completion date of each task shall be noted in the minutes of the meeting following the task completion.

2. Schedules:

The Consultant; with the input from the Client Agency Representative and Project Manager, shall review and recommend approval of the project construction schedule prepared by the Contractor. The schedule shall identify all necessary start and completion dates of construction, construction activities, submittal process activities, material deliveries and other milestones required to give a complete review of the project.

The Consultant shall record any schedule delays, the party responsible for the delay, the schedule activity affected, and the original and new date for reference.

The Consultant shall ensure that the Contractor provides a two (2) week “look ahead” construction schedule based upon the current monthly updated schedule as approved at the bi-weekly job meetings and that identifies the daily planned activities for that period. This Contractor requirement must also be included in Division 1 of the specification for reference.

3. Submittal Log:

Based on the Submittal Schedule in Division 1 of the specifications, the Consultant shall develop and implement a submittal log that includes all of the required project submittals as identified in the general conditions and technical specifications. The submittal log shall be provided to the contractor at the pre-construction meeting. The dates of submission shall be determined and approved by all affected parties during the pre-construction meeting.

Examples of the submissions to be reviewed and approved by the Consultant and Sub-Consultant (if required) include: project schedule, schedule of values, shop drawings, equipment and material catalog cuts, spec sheets, product data sheets, MSDS material safety data sheets, specification procedures, color charts, material samples, mock-ups, etc. The submittal review process must be conducted at each job progress meeting and shall include the Consultant, Sub-Consultant, Contractor, Project Manager, and designated representatives of the Client Agency.

The Consultant shall provide an updated submittal log at each job meeting that highlights the status of all required submissions.

F. CONSTRUCTION SITE ADMINISTRATION SERVICES

The Consultant and Sub-Consultant(s) shall provide construction site administration services during the duration of the project. The Consultant and Sub-Consultant(s) do not necessarily have to be on site concurrently if there are no critical activities taking place that require the Sub-Consultant’s participation.

The services required shall include, but not be limited to; field observations sufficient to verify the quality and progress of construction work, conformance and compliance with the contract documents, and to attend/chair meetings as may be required by the Project Manager to resolve special issues.

Consultant and Sub-Consultant(s) shall conduct weekly site inspection/field observation visits. Site inspection/field observation visits may be conducted in conjunction with regularly scheduled bi-weekly construction job meetings, depending on the progress of work, for weeks that construction job meetings are scheduled. The Consultant and their Sub-Consultant(s) shall submit a field observation report for each site inspection to the Project Manager within three (3) calendar days of the site visit. Also, they shall conduct inspections during major construction activities including, but not limited to the following examples: concrete pours, steel and truss installations, code inspections, final testing of systems, achievement of each major milestone

required on the construction schedule, and requests from the Project Manager. The assignment of a full time on-site Sub-Consultant does not relieve the Consultant of their site visit obligation.

The Consultant shall refer to Section XIV. Contract Deliverables of this Scope of Work subsection entitled “Construction Phase” to determine the extent of services and deliverables required during this phase of the project.

G. SUB-CONSULTANT PARTICIPATION

It is the responsibility of the Consultant to ensure that they have provided adequate hours and/or time allotted in their technical proposal so that their Sub-Consultants may participate in all appropriate phases and activities of this project or whenever requested by the Project Manager. This includes the pre-proposal site visit and the various design meetings and construction job meetings, site visits, and close-out activities described in this Scope of Work. Field observation reports and/or meeting minutes are required to be submitted to the Project Manager within three (3) calendar days of the site visit or meeting. All costs associated with such services shall be included in the base bid of the Consultant’s fee proposal.

H. DRAWINGS

1. Shop Drawings:

Each Contractor shall review the specifications and determine the numbers and nature of each shop drawing submittal. Five (5) sets of the documents shall be submitted with reference made to the appropriate section of the specification. The Consultant shall review the Contractor’s shop drawing submissions for conformity with the construction documents within seven (7) calendar days of receipt. The Consultant shall return each shop drawing submittal stamped with the appropriate action, i.e. “Approved”, “Approved as Noted”, “Approved as Noted Resubmit for Records”, “Rejected”, etc.

2. As-Built & Record Set Drawings:

The Contractor(s) shall keep the contract drawings up-to-date at all times during construction and upon completion of the project, submit their AS-BUILT drawings to the Consultant with the Contractor(s) certification as to the accuracy of the information prior to final payment. All AS-BUILT drawings submitted shall be entitled AS-BUILT above the title block and dated.

The Consultant shall review the Contractor(s)’ AS-BUILT drawings at each job progress meeting to ensure that they are up-to-date. Any deficiencies shall be noted in the progress meeting minutes.

The Consultant shall acknowledge acceptance of the AS-BUILT drawings by signing a transmittal indicating they have reviewed them and that they reflect the AS-BUILT conditions as they exist.

Upon receipt of the AS-BUILT drawings from the Contractor(s), the Consultant shall obtain the original reproducible drawings from DPMC and transfer the AS-BUILT conditions to the original full sized signed reproducible drawings to reflect RECORD conditions within fourteen (14) calendar days of receipt of the AS-BUILT information.

The Consultant shall note the following statement on the original RECORD-SET drawings. “The AS-BUILT information added to this drawing(s) has been supplied by the Contractor(s). The Architect/Engineer does not assume the responsibility for its accuracy other than conformity with the design concept and general adequacy of the AS-BUILT information to the best of the Architect’s/Engineer’s knowledge.”

Upon completion, The Consultant shall deliver the RECORD-SET original reproducible drawings to DPMC who will acknowledge their receipt in writing. This hard copy set of drawings and two (2) sets of current release AUTO CAD discs shall be submitted to DPMC. The discs shall contain all AS-BUILT drawings in both “.dwg” (native file format for AUTO CAD) and “.pdf” (*Adobe* portable document format) file formats.

I. CONSTRUCTION DEFICIENCY LIST

The Consultant shall prepare, maintain and continuously distribute an on-going deficiency list to the Contractor, Project Manager, and Client Agency Representative during the construction phase of the project. This list shall be separate correspondence from the field observation reports and shall not be considered as a punch list.

J. INSPECTIONS: SUBSTANTIAL & FINAL COMPLETION

The Consultant and their Sub-Consultant(s) accompanied by the Project Manager, Code Inspection Group, Client Agency Representative and Contractor shall conduct site inspections to determine the dates of substantial and final completion. The Project Manager will issue the only recognized official notice of substantial completion. The Consultant shall prepare and distribute the coordinated punch list, written warranties and other related DPMC forms and documents, supplied by the Contractor, to the Project Manager for review and certification of final contract acceptance.

If applicable, the punch list shall include a list of attic stock and spare parts.

K. CLOSE-OUT DOCUMENTS

The Consultant shall review all project close-out documents as submitted by the Contractors to ensure that they comply with the requirements listed in the “Procedure for Architects and Engineers’ Manual.” The Consultant shall forward the package to the Project Manager within fourteen (14) calendar days from the date the Certificate of Occupancy/Certificate of Approval is issued. The Consultant shall also submit a letter certifying that the project was completed in accordance with the contract documents, etc.

L. CLOSE-OUT ACTIVITY TIME

The Consultant shall provide all activities and deliverables associated with the “Close-Out Phase” of this project as part of their Lump Sum base bid. The Consultant and/or Sub-Consultant(s) may not use this time for additional job meetings or extended administrative services during the Construction Phase of the project.

M. TESTING, TRAINING, MANUALS AND ATTIC STOCK

The Consultant shall ensure that all equipment testing, training sessions and equipment manuals required for this project comply with the requirements identified below.

1. Testing:

All equipment and product testing conducted during the course of construction is the responsibility of the Contractor. However, the Consultant shall ensure the testing procedures comply with manufacturers recommendations. The Consultant shall review the final test reports and provide a written recommendation of the acceptance/rejection of the material, products or equipment tested within seven (7) calendar days of receipt of the report.

2. Training:

The Consultant shall include in the specification that the Contractor shall schedule and coordinate all equipment training with the Project Manager and Client Agency representatives. It shall state that the Contractor shall submit the Operation and Maintenance (O&M) manuals, training plan contents, and training durations to the Consultant, Project Manager and Client Agency Representative for review and approval prior to the training session.

The Consultant shall ensure that the training session is video recorded by the Contractor. A copy of the recording shall be transmitted to the Project Manager who will forward the material to the Client Agency for future reference.

All costs associated with the training sessions shall be borne by the Contractor installing the equipment. A signed letter shall be prepared stating when the training was completed and must be accompanied with the training session sign-in sheet as part of the project close-out package.

3. Operation & Maintenance Manuals:

The Consultant shall coordinate and review the preparation and issuance of the equipment manuals provided by the Contractor(s) ensuring that they contain the operating procedures, maintenance procedures and frequency, cut sheets, parts lists, warranties, guarantees, and detailed drawings for all equipment installed at the facility.

A troubleshooting guide shall be included that lists problems that may arise, possible causes with solutions, and criteria for deciding when equipment shall be repaired and when it must be replaced.

Include a list of the manufacturer's recommended spare parts for all equipment being supplied for this project.

A list of names, addresses and telephone numbers of the Contractors involved in the installations and firms capable of performing services for each mechanical item shall be included. The content of the manuals shall be reviewed and approved by the Project Manager and Client Agency Representative.

The Consultant shall include in the specification that the Contractor must provide a minimum of ten (10) "throwaway" copies of the manual for use at the training seminar and seven (7) hardbound copies as part of the project close-out package.

4. Attic Stock:

The Consultant shall determine and recommend whether "attic stock" should be included for all aspects of the project. If required, the Consultant shall specify attic stock items to be included in the project.

Prior to project close-out, the Consultant must prepare a comprehensive listing of all items for delivery by the Contractor to the Owner and in accordance with the appropriate specification/plan section. Items shall include, but not be limited to: training sessions, O&M manuals, as-built drawings, itemized attic stock requirements, and manufacturer guarantees/warranties.

N. CHANGE ORDERS

The Consultant shall review and process all change orders in accordance with the contract documents and procedures described below.

1. Consultant:

The Consultant shall prepare a detailed request for Change Order including a detailed description of the change(s) along with appropriate drawings, specifications, and related documentation and submit the information to the Contractor for the change order request submission. This will require the use of the current DPMC 9b form.

2. Contractor:

The Contractor shall submit a DPMC 9b Change Order Request form to the Project Manager within seven (7) calendar days after receiving the Change Order from the Consultant. The document shall identify the changed work in a manner that will allow a clear understanding of the necessity for the change. Copies of the original design drawings, sketches, etc. and specification pages shall be highlighted to clarify and show entitlement to the Change Order.

Copies shall be provided of job minutes or correspondence with all relative information highlighted to show the origin of the Change Order. Supplementary drawings from the Consultant shall be included if applicable that indicate the manner to be used to complete the changed work. A detailed breakdown of all costs associated with the change, i.e. material, labor, equipment, overhead, Sub-Contractor work, profit and bond, and certification of increased bond shall be provided.

If the Change Order will impact the time of the project, the Contractor shall include a request for an extension of time. This request shall include a copy of the original approved project schedule and a proposed revised schedule that reflects the impact on the project completion date. Documentation to account for the added time requested shall be included to support entitlement of the request such as additional work, weather, other Contractors, etc. This documentation shall contain dates, weather data and all other relative information.

3. Recommendation for Approval:

The Consultant shall evaluate the reason for the change in work and provide a detailed written recommendation for approval or disapproval of the Change Order Request including backup documentation of costs in CSI format and all other considerations to substantiate that decision.

4. Code Review:

The Consultant shall determine if the Change Order request will require Code review and shall submit six (6) sets of signed and sealed modified drawings and specifications to the DPMC Plan & Code Review Unit for approval, if required. The Consultant must also determine and produce a permit amendment request if required.

5. Cost Estimate:

The Consultant shall provide a detailed cost estimate of the proposed Change Order Request, as submitted by the Contractor, in CSI format (latest edition) for all appropriate divisions and sub-divisions using a recognized estimating formula. The estimate shall then be compared with that of the Contractor's estimate. If any line item in the Consultant's estimate is lower than the corresponding line item in the Contractor's estimate, the Consultant in conjunction with the Project Manager is to contact the Contractor by telephone and negotiate the cost differences. The Consultant shall document the negotiated agreement on the Change Order Request form. If the Contractor's total dollar value changes based on the negotiations, the Consultant shall identify the changes on the Change Order Request form accordingly.

When recommending approval or disapproval of the change order, the Consultant shall be required to prepare and process a Change Order package that contains at a minimum the following documents:

- DPMC 9b Change Order Request
- DPMC 10 Consultant's Evaluation of Contractor's Change Order Request
- Consultant's Independent Detailed Cost Estimate
- Notes of Negotiations

6. Time Extension:

When a Change Order Request is submitted with both cost and time factors, the Consultant's independent cost estimate is to take into consideration time factors associated with the changed work. The Consultant is to compare their time element with that of the Contractor's time request and if there is a significant difference, the Consultant in conjunction with the Project Manager is to contact the Contractor by telephone and negotiate the difference.

When a Change Order Request is submitted for time only, the Consultant is to do an independent evaluation of the time extension request using a recognized scheduling formula.

Requests for extension of contract time must be done in accordance with the General Conditions Article 10.1 "Changes in the Work".

7. Submission:

The Consultant shall complete all of the DPMC Change Order Request forms provided and submit a completed package to the Project Manager with all appropriate backup documentation within seven (7) calendar days from receipt of the Contractor's change order request. The Consultant shall resubmit the package at no cost to the State if the change order package contents are deemed insufficient by the Project Manager.

8. Meetings:

The Consultant shall attend and actively participate at all administrative hearings or settlement conferences as may be called by Project Manager in connection with such Change Orders and provide minutes of those meetings to the Project Manager for distribution.

9. Consultant Fee:

All costs associated with the potential Contractor Change Order Requests shall be anticipated by the Consultant and included in the base bid of their fee proposal.

If the Client Agency Representative requests a scope change; and it is approved by the Project Manager, the Consultant may be entitled to be reimbursed through an amendment and in accordance with the requirements stated in paragraph 10.01 of this Scope of Work.

IX. PERMITS & APPROVALS

A. NJ UNIFORM CONSTRUCTION CODE PERMIT

The project construction documents must comply with the latest adopted edition of the NJ Uniform Construction Code (NJUCC).

The latest NJUCC Adopted Codes and Standards can be found at:

<http://www.state.nj.us/dca/divisions/codes/codreg/>

1. NJ Uniform Construction Code (NJUCC) Plan Review

Consultant shall estimate the cost of the NJUCC Plan Review by DCA and include that amount in their fee proposal line item entitled “**Plan Review and Permit Fee Allowance**”, refer to paragraph XI.A.

Upon approval of the Final Design Phase Submission by DPMC, the Consultant shall submit the construction documents to the Department of Community Affairs (DCA), Bureau of Construction Project Review, Health Care Plan Review Unit to secure a complete plan release.

Procedures for submission to the Health Care Plan Review Unit can be found at:

http://www.state.nj.us/dca/divisions/codes/forms/pdf_bcpr/hcpr_procedures.pdf

Consultant shall complete the “Project Review Application” and include the following on Block 5 as the “Owner’s Designated Agent Name”:

Mark Connolly, DPMC
PO Box 235
Trenton, NJ 08625-0235
mark.connolly@treas.nj.gov 609-633-1361

The Consultant shall complete the NJUCC “Plan Review Fee Schedule”, determine the fee due and pay the NJUCC Plan Review fees, refer to Paragraph XI.A.

The NJUCC “Plan Review Fee Schedule” can be found at:

http://www.state.nj.us/dca/divisions/codes/forms/pdf_bcpr/pr_fees.pdf

2. NJ Uniform Construction Code Permit

Upon receipt of a complete plan release from the DCA Bureau of Construction Project Review, Health Care Plan Review Unit, the Consultant shall complete the NJUCC permit application and all applicable technical sub-code sections. The “Agent Section” of the application and certification section of the building sub-code section shall be signed. These documents, with **five (5) sets of DCA approved, signed and sealed construction documents** shall be forwarded to the DPMC Project Manager.

The Consultant may obtain copies of all NJUCC permit applications at the following website:

<http://www.state.nj.us/dca/divisions/codes/forms/>

All other required project permits shall be obtained and paid for by the Consultant in accordance with the procedures described in Paragraph IX.B.

3. Prior Approval Certification Letters:

The issuance of a construction permit for this project may be contingent upon acquiring various “prior approvals” as defined by N.J.A.C. 5:23-1.4. It is the Consultant’s responsibility to determine which prior approvals, if any, are required. The Consultant shall submit a general certification letter to the DPMC Plan & Code Review Unit Manager during the Permit Phase of this project that certifies all required prior approvals have been obtained.

In addition to the general certification letter discussed above, the following specific prior approval certification letters, where applicable, shall be submitted by the Consultant to the DPMC Plan & Code Review Unit Manager: Soil Erosion & Sediment Control, Water & Sewer Treatment Works Approval, Coastal Areas Facilities Review, Compliance of Underground Storage Tank Systems with N.J.A.C. 7:14B, Pinelands Commission, Highlands Council, Well Construction and Maintenance; Sealing of Abandoned Wells with N.J.A.C. 7:9D, Certification that all utilities have been disconnected from structures to be demolished, Board of Health

Approval for Potable Water Wells, Health Department Approval for Septic Systems. It shall be noted that in accordance with N.J.A.C. 5:23-2.15(a)5, a permit cannot be issued until the letter(s) of certification is received.

4. Multi-building or Multi-Site Permits:

A project that involves many buildings and/or sites requires that a separate permit shall be issued for each building or site. The Consultant must determine the construction cost estimate for *each* building and/or site location and submit that amount where indicated on the permit application.

5. Special Inspections:

In accordance with the requirements of the New Jersey Uniform Construction Code N.J.A.C. 5:23-2.20(b), Bulletin 03-5 and Chapter 17 of the International Building Code, the Consultant shall be responsible for the coordination of all special inspections during the construction phase of the project.

Bulletin 03-5 can be found at:

http://www.state.nj.us/dca/divisions/codes/publications/pdf_bulletins/b_03_5.pdf

a. Definition:

Special inspections are defined as an independent verification by a certified Special Inspector for **Class I buildings and smoke control systems in any class building**. The special inspector is to be independent from the Contractor and responsible to the Consultant so that there is no possible conflict of interest.

Special inspectors shall be certified in accordance with the requirements in the New Jersey Uniform Construction Code.

b. Responsibilities:

The Consultant shall submit with the permit application, a list of special inspections and the agencies or special inspectors that will be responsible to carry out the inspections required for the project. The list shall be a separate document, on letter head, signed and sealed.

B. OTHER REGULATORY AGENCY PERMITS, CERTIFICATES AND APPROVALS

The Consultant shall identify and obtain all other State Regulatory Agency permits, certificates, and approvals that will govern and affect the work described in this Scope of Work. An itemized list of these permits, certificates, and approvals shall be included with the Consultant's Technical

Proposal and the total amount of the application fees should be entered in the Fee Proposal line item entitled, **“Plan Review and Permit Fee Allowance”**.

The Consultant may refer to the Division of Property Management and Construction “Procedures for Architects and Engineers Manual”, Section 6.4.8, which presents a compendium of State permits, certificates, and approvals that may be required for this project.

The Consultant shall determine the appropriate phase of the project to submit the permit application(s) in order to meet the approved project milestone dates.

Where reference to an established industry standard is made, it shall be understood to mean the most recent edition of the standard unless otherwise noted. If an industry standard is found to be revoked, or should the standard have undergone substantial change or revision from the time that the Scope of Work was developed, the Consultant shall comply with the most recent edition of the standard.

C. STATE INSURANCE APPROVAL

The Consultant shall respond in writing to the FM Global Insurance Underwriter plan review comments through the DPMC Plan & Code Review Unit Manager as applicable. The Consultant shall review all the comments and, with agreement of the Project Team, modify the documents while adhering to the project’s SOW requirements, State code requirements, schedule, budget, and Consultant fee.

D. PUBLIC EMPLOYEES OCCUPATIONAL SAFETY & HEALTH PROGRAM

A paragraph shall be included in the design documents, if applicable to this project that states: The Contractor shall comply with all the requirements stipulated in the Public Employees Occupational Safety & Health Program (PEOSHA) document, paragraph 12:100-13.5 entitled “Air quality during renovation and remodeling”. The Contractor shall submit a plan demonstrating the measures to be utilized to confine the dust, debris, and air contaminants in the renovation or construction area of the project site to the Project Team prior to the start of construction.

The link to the document is: <http://www.state.nj.us/health/eoh/peoshweb/iaqstd.pdf>

E. PERMIT MEETINGS

The Consultant shall attend and chair all meetings with Permitting Agencies necessary to explain and obtain the required permits.

F. MANDATORY NOTIFICATIONS

The Consultant shall include language in Division 1 of the specification that states the Contractor shall assure compliance with the New Jersey “One Call” Program (1-800-272-1000) if any excavation is to occur at the project site.

The One Call Program is known as the “New Jersey Underground Facility Protection Act”, refer to N.J.A.C. 14:2.

G. CONSULTANT FEE

The Consultant shall determine the efforts required to complete and submit all permit applications, obtain and prepare supporting documentation, attend meetings, etc., and include the total cost in the base bid of their fee proposal under the “Permit Phase”.

X. GENERAL REQUIREMENTS

A. SCOPE CHANGES

The Consultant must request any changes to this Scope of Work in writing. An approved DPMC 9c Consultant Amendment Request form reflecting authorized scope changes must be received by the Consultant prior to undertaking any additional work. The DPMC 9c form must be approved and signed by the Director of DPMC and written authorization issued from the Project Manager prior to any work being performed by the Consultant. Any work performed without the executed DPMC 9c form is done at the Consultant’s own financial risk.

B. ERRORS AND OMISSIONS

The errors and omissions curve and the corresponding sections of the “Procedures for Architects and Engineers Manual” are eliminated. All claims for errors and omissions will be pursued by the State on an individual basis. The State will review each error or omission with the Consultant and determine the actual amount of damages, if any, resulting from each negligent act, error or omission.

C. ENERGY INCENTIVE PROGRAM

The Consultant shall review the programs described on the “New Jersey’s Clean Energy Program” website at: <http://www.njcleanenergy.com> to determine if any proposed upgrades to the mechanical and/or electrical equipment and systems for this project qualify for “New Jersey Clean Energy Program” rebates and incentives such as Smart Start, Pay4Performance, Direct Install or any other incentives.

The Consultant shall be responsible to complete the appropriate registration forms and applications, provide any applicable worksheets, manufacturer's specification sheets, calculations, attend meetings, and participate in all activities with designated representatives of the programs and utility companies to obtain the entitled financial incentives and rebates for this project. All costs associated with this work shall be estimated by the Consultant and the amount included in the base bid of their fee proposal.

XI. ALLOWANCES

A. PLAN REVIEW AND PERMIT FEE ALLOWANCE

The Consultant shall pay all DCA plan review fees and regulatory permit fees (except the NJ Uniform Construction Code permit) in accordance with the guidelines identified below.

1. Permits:

The Consultant shall determine the various permits, certificates, and approvals required to complete this project.

2. Permit Costs:

The Consultant shall estimate the application fee costs for all of the required plan reviews, permits, certificates, and approvals (excluding the NJ Uniform Construction Code permit) and include that amount in their fee proposal line item entitled "**Plan Review and Permit Fee Allowance**", refer to Paragraph IX.A. A breakdown of each permit and application fee shall be attached to the fee proposal for reference.

NOTE: The NJ Uniform Construction Code permit is excluded since it will be paid by the Contractor.

3. Applications:

The Consultant shall complete and submit all permit applications to the appropriate permitting authorities and the costs shall be paid from the Consultant's permit fee allowance. A copy of the application(s) and the original permit(s) obtained by the Consultant shall be given to the DPMC Project Manager for distribution during construction.

4. Consultant Fee:

The Consultant shall determine what is required to complete and submit the permit applications, obtain supporting documentation, attend meetings, etc., and include the total cost in the base bid of their fee proposal under the "Permit Phase" column.

Any funds remaining in the permit allowance will be returned to the State at the close of the project.

B. HAZARDOUS MATERIALS TESTING AND REPORT ALLOWANCE

Consultant shall estimate the costs to complete the hazardous materials survey, sample collection, testing and analysis and preparation of a “Hazardous Materials Survey Report” noted in paragraph VII.F and enter that amount on their fee proposal line item entitled “**Hazardous Materials Testing and Report Allowance**”. Consultant shall attach a detailed cost breakdown sheet for use by DPMC during the proposal review and potential fee negotiations. The cost breakdown sheet shall include, but not be limited to, the following information:

- Description of tasks and estimated cost for the following:
 - Sample collection
 - Sample testing
 - Preparation of a Hazardous Materials Survey Report

Any funds remaining in the Hazardous Materials Testing and Report Allowance will be returned to the State at the close of the project.

C. HAZARDOUS MATERIALS ABATEMENT DESIGN ALLOWANCE

Consultant shall estimate the costs to prepare construction documents for hazardous materials abatement noted in paragraph VII.F and enter that amount on their fee proposal line item entitled “**Hazardous Materials Abatement Design Allowance**”. Consultant shall attach a detailed cost breakdown sheet for use by DPMC during the proposal review and potential fee negotiations. The cost breakdown sheet shall include a description of the tasks to be performed and the estimated cost of each task.

Any funds remaining in the Hazardous Materials Abatement Design Allowance will be returned to the State at the close of the project.

D. HAZARDOUS MATERIALS CONSTRUCTION ADMINISTRATION ALLOWANCE

Consultant shall estimate the cost to provide Construction Monitoring and Administration Services for hazardous materials abatement as noted in paragraph VII.F and enter that amount on their fee proposal line item entitled “**Hazardous Materials Construction Administration Allowance**”. Consultant shall attach a detailed cost breakdown sheet for use by DPMC during the proposal review and potential fee negotiations. The cost breakdown sheet shall include a description of the tasks to be performed and the estimated cost of each task.

Any funds remaining in the Hazardous Materials Construction Administration Allowance will be returned to the State at the close of the project.

E. WATER SUPPLY UPGRADE ALLOWANCE

The hydrant test results shall be used as the basis for hydraulic calculations to verify that there is adequate water pressure and flow for the building sprinkler system. Signed and sealed calculations must be submitted to the DPMC Plan & Code Review Unit for record. The Consultant shall estimate the costs associated with the potential requirement to upgrade the building water supply system and enter that amount in their fee proposal line item entitled **“Water Supply Upgrade Allowance”**.

Any funds remaining in the allowance account will be returned to the State at the close of the project.

F. FIRE DETECTION SYSTEM UPGRADE ALLOWANCE

Upgrade or replace the existing fire alarm panel, annunciator panel(s) and any other related component of the fire detection system based on capacity, compatibility with the new fire suppression system, age, and condition. The Consultant shall estimate the potential costs for the design and construction administration services necessary to upgrade the existing fire detection system and include that amount in their fee proposal line item entitled **“Fire Detection Upgrade Allowance.”**

Any funds remaining in the allowance account will be returned to the State at the close of the project.

XII. SUBMITTAL REQUIREMENTS

A. CONTRACT DELIVERABLES

All submissions shall include the Contract Deliverables identified in Section XIV of this Scope of Work and described in the DPMC Procedures for Architects and Engineers Manual.

B. CATALOG CUTS

The Consultant shall provide catalog cuts as required by the DPMC Plan & Code Review Unit during the design document review submissions. Examples of catalog cuts include, but are not limited to: mechanical equipment, hardware devices, plumbing fixtures, fire suppression and alarm components, specialized building materials, electrical devices, etc.

C. PROJECT DOCUMENT BOOKLET

The Consultant shall submit all of the required Contract Deliverables to the Project Manager at the completion of each phase of the project. All reports, meeting minutes, plan review comments, project schedule, cost estimate in CSI format (latest edition), correspondence, calculations, and other appropriate items identified on the Submission Checklist form provided in the A/E Manual shall be presented in an 8½” x 11” bound “booklet” format.

D. DESIGN DOCUMENT CHANGES

Any corrections, additions, or omissions made to the submitted drawings and specifications at the Permit Phase of the project must be submitted to DPMC Plan & Code Review Unit as a complete document. Corrected pages or drawings may not be submitted separately unless the Consultant inserts the changed page or drawing in the original documents. No Addendums or Bulletins will be accepted as a substitution to the original specification page or drawing.

E. SINGLE-PRIME CONTRACT

All references to “separate contracts” in the Procedures for Architects and Engineers Manual, Chapter 8, shall be deleted since this project will be advertised as a “Single Bid” (Lump Sum All Trades) contract. The single prime Contractor will be responsible for all work identified in the drawings and specifications.

The drawings shall have the required prefix designations and the specification sections shall have the color codes as specified for each trade in the DPMC Procedure for Architects and Engineers Manual.

The Consultant must still develop the Construction Cost Estimate (CCE) for each trade and the amount shall be included on the DPMC-38 Project Cost Analysis form where indicated. This document shall be submitted at each design phase of the project and updated immediately prior to the advertisement to bid.

PROJECT NAME: Fire Suppression, Various Buildings
PROJECT LOCATION: Woodbine Developmental Center
PROJECT NO: M1537-00
DATE: 02/13/2020

XIII. SOW SIGNATURE APPROVAL SHEET

This Scope of Work shall not be considered a valid document unless all signatures appear in each designated area below.

The Client Agency approval signature on this page indicates that they have reviewed the design criteria and construction schedule described in this project Scope of Work and verifies that the work will not conflict with the existing or future construction activities of other projects at the site.

SOW PREPARED BY:  02/13/2020
DOAA ABOUELELA, PROJECT MANAGER DATE
DPMC PROJECT PLANNING & INITIATION

SOW APPROVED BY:  2/13/2020
JAMES WRIGHT, MANAGER DATE
DPMC PROJECT PLANNING & INITIATION

SOW APPROVED BY:  02/14/2020
CHRISTIAN CASTEEL, ADMIN. ANALYST DATE
DEPARTMENT OF HUMAN SERVICES

SOW APPROVED BY:  2/13/2020
RICHARD HERRERO, PROJECT MANAGER DATE
DPMC PROJECT MANAGEMENT GROUP

SOW APPROVED BY:  2/18/20
RICHARD FLODMAN, DEPUTY DIRECTOR DATE
DIV PROPERTY MGT & CONSTRUCTION

XIV. CONTRACT DELIVERABLES

The following is a listing of Contract Deliverables that are required at the completion of each phase of this project. The Consultant shall refer to the DPMC publication entitled, "Procedures for Architects and Engineers," Volumes I and II, 2nd Edition, dated January, 1991 to obtain a more detailed description of the deliverables required for each item listed below.

The numbering system used in this "Contract Deliverables" section of the scope of work corresponds to the numbering system used in the "Procedures for Architects and Engineers" manual and some may have been deleted if they do not apply to this project.

INVESTIGATION PHASE:

- 6.1 Project Schedule (Update Bar Chart Schedule)**
- 6.2 Meetings & Minutes (Minutes within seven (7) calendar days of meeting)**
Oral Presentation Meeting at Woodbine Developmental Center (WDC)
- 6.3 Correspondence**
- 6.4 Submission Requirements**

Investigation Report
- 6.5 Approval**

6.5.1 Respond to Submission Comments
- 6.6 Submission Forms**

Figure 6.4.10 Plan Review Record Sheet
Figure 6.4.12 Current Working Estimate/Cost Analysis
Figure 6.4.16 Submission Checklist

DESIGN DEVELOPMENT PHASE: 50% Complete Design Documents (Minimum)

- 7.1 Project Schedule (Update Bar Chart Schedule)**
 - 7.2 Meetings & Minutes (Minutes within seven (7) calendar days of meeting)**
Working Meeting at Woodbine Developmental Center (WDC)
 - 7.3 Correspondence**
-
-

7.4 Submission Requirements

- 7.4.1 A/E Statement of Site Visit, As-Built Drawing Verification (if available)
- 7.4.2 Space Analysis & Program Requirements
- 7.4.3 Special Features Description: communications, security, fire protection, special structural features, etc.
- 7.4.4 Site Evaluation
- 7.4.8 Regulatory Agency Approvals (See Section 6.4.8 for listing)
- 7.4.9 Confirm Utility Availability (On Site & Public)
 - Fire Service
 - Electric Service
- 7.4.10 Drawings: 6 sets
 - Cover Sheet (See A/E Manual for format)
 - Site Plan
 - Site Utility Plan
 - Floor Plans
 - Elevations
 - Sections/Details
 - Structural Drawings, Seismic Design Load Criteria
 - Fire Protection Drawings, Hydraulic Calcs, Water Pressure & Flow Data
 - Electrical Drawings, Riser Diagram, Panel Schedules, Service Size, Lighting Design
- 7.4.11 Specifications: 6 sets (See A/E Manual for format, include Division 1 and edit to describe the administrative and general requirements of the project)
- 7.4.12 Current Working Estimate in CSI Format & Cost Analysis 38 Form
- 7.4.13 Bar Chart of Design and Construction Schedule
- 7.4.14 Oral Presentation of Submission to Project Team at WDC
- 7.4.15 SOW Compliance Statement
- 7.4.16 This Submission Checklist (See A/E Manual, Figure 6.4.16 for format)
- 7.4.17 Deliverables Submission in Booklet Form: 7 sets

7.5 Approval

- 7.5.1 Respond to Submission Comments

7.6 Submission Forms

- Figure 7.4.12 Current Working Estimate/Cost Analysis
- Figure 7.4.16 Submission Checklist

FINAL DESIGN PHASE 100% Complete Construction Documents

This Final Design Phase may require more than one submission based on the technical quality and code conformance of the design documents.

8.1 Schedule (Update Bar Chart Schedule)

8.2 Meeting & Minutes (Minutes within seven (7) calendar days of meeting)
Working Meeting at Woodbine Developmental Center (WDC)

8.3 Correspondence

8.4 Submission Requirements

- 8.4.1 A/E Statement of Site Visit
- 8.4.2 Space Analysis
- 8.4.3 Special Features Description, (Fire)
- 8.4.4 Site Evaluation
- 8.4.8 Regulatory Agency Approvals (Include itemized list specific to this project)
- 8.4.10 Drawings: 6 sets
- 8.4.11 Specifications: 6 sets
- 8.4.12 Current Working Estimate in CSI Format & Cost Analysis 38 Form
- 8.4.13 Bar Chart of Design and Construction Schedule
- 8.4.14 Oral Presentation of this Submission to Project Team
- 8.4.15 Plan Review/SOW Compliance Statement
- 8.4.16 This Submission Checklist
- 8.4.17 Deliverables Submission in Booklet Form: 7 sets

8.5 Approvals

- 8.5.1 Respond to Submission Comments

PERMIT APPLICATION PHASE

This Permit Application Phase should not include any additional design issues. Design documents shall be 100% complete at the Final Design Phase.

8.6 Permit Application Submission Requirements

- 8.6.1 - 8.6.7: If all of the deliverables of these sections have been previously submitted to DPMC and approved there are no further deliverables due at this time
- 8.6.8 Regulatory Agency Approvals
 - (a) UCC Permit Application & Technical Sub-codes completed by A/E
- 8.6.9 Utility Availability Confirmation

- 8.6.10 Signed and Sealed Drawings: 6 sets
- 8.6.11 Signed and Sealed Specifications: 6 sets
- 8.6.12 Current Working Estimate/Cost Analysis
- 8.6.13 Bar Chart Schedule
- 8.6.14 Project Presentation (N/A this Project)
- 8.6.15 Plan Review/SOW Compliance Statement
- 8.6.16 Submission Checklist

8.7 Approvals

8.8 Submission Forms

- Figure 8.4.12 Current Working Estimate/Cost Analysis
- Figure 8.4.16 Submission Checklist (Final Review Phase)
- Figure 8.6.12-b Bid Proposal Form (Form DPMC -3)
- Figure 8.6.12-c Notice of Advertising (Form DPMC -31)
- Figure 8.6.16 Submission Checklist (Permit Phase)
- Figure 8.7 Bid Clearance Form (Form DPMC -601)

BIDDING AND CONTRACT AWARD

9.0 Bidding Phase Requirements

- 9.01 Original Drawings signed & sealed by A/E and drawings on compact disk (CD) in *Adobe Portable Document Format (.pdf)*
- 9.02 One Unbound Specification Color Coded per A/E Manual Section 8.4.11 and specifications on compact disk (CD) in *Adobe Portable Document Format (.pdf)*
- 9.03 Bid Documents Checklist
- 9.04 Bid Proposal Form
- 9.05 Notice for Advertising

9.1 Chair Pre-Bid Conference/Mandatory Site Visit

9.2 Prepare Bulletins

9.3 Attend Bid Opening

9.4 Recommendation for Contract Award

- 9.4.1 Prepare Letter of Recommendation for Award & Cost Analysis

9.5 Attend Pre-Construction Meeting

9.6 Submission Checklist

9.7 Submission Forms

- Figure 9.4.1 Cost Analysis
- Figure 9.6 Submission Checklist

CONSTRUCTION PHASE

10.1 Site Construction Administration

10.2 Pre-Construction Meeting

10.3 Construction Job Meetings

- 10.3.1 Agenda: Schedule and Chair Construction Job Meetings
- 10.3.2 Minutes: Prepare and Distribute Minutes within 5 working days of meeting
- 10.3.3 Schedules; Approve Contractors' Schedule & Update
- 10.3.4 Minutes Format: Prepare Job Meeting Minutes in approved format, figure 10.3.4-a

10.4 Correspondence

10.5 Prepare and Deliver Conformed Drawings

10.7 Approve Contractors Invoicing and Payment Process

10.8 Approve Contractors 12/13 Form for Subs, Samples and Materials

10.10 Approve Test Reports

10.11 Approve Shop Drawings

10.12 Construction Progress Schedule

- 10.12.1 Construction Progress Schedule

10.13 Review & Recommend or Reject Change Orders

- 10.13.1 Scope Changes
- 10.13.2 Construction Change Orders
- 10.13.3 Field Changes

10.14 Construction Photographs

10.15 Submit Field Observation Reports

10.16 Submission Forms

- Figure 10.3.4-a Job Meeting Format of Minutes
- Figure 10.3.4-b Field Report
- Figure 10.6 DPMC Insurance Form-24
- Figure 10.6-a Unit Schedule Breakdown
- Figure 10.6-b Monthly Estimate for Payment to Contractor DPMC 11-2
- Figure 10.6-c Monthly Estimate for Payment to Contractor DPMC 11-2A
- Figure 10.6-d Invoice DPMC 11
- Figure 10.6-e Prime Contractor Summary of Stored Materials DPMC 11-3
- Figure 10.6-f Agreement & Bill of Sale certificate for Stored Materials DPMC 3A
- Figure 10.7-a Approval Form for Subs, Samples & Materials DPMC 12
- Figure 10.7-b Request for Change Order DPMC 9b
- Figure 10.9 Transmittal Form DPMC 13
- Figure 10.10 Submission Checklist

PROJECT CLOSE-OUT PHASE

11.1 Responsibilities: Plan, Schedule and Execute Close-Out Activities

11.2 Commencement: Initiate Close-Out w/DPMC 20A Project Close-Out Form

11.3 Develop Punch List & Inspection Reports

11.4 Verify Correction of Punch List Items

11.5 Determination of Substantial Completion

11.6 Ensure Issuance of “Temporary Certificate of Occupancy or Approval”

11.7 Initiation of Final Contract Acceptance Process

11.8 Submission of Close-Out Documentation

- 11.8.1 As-Built & Record Set Drawings, 3 sets AUTOCAD Discs Delivered to DPMC
- 11.8.2 (a) Maintenance and Operating manuals, Warranties, etc.: 7 sets each
 - (b) Guarantees
 - (c) Shop Drawings
 - (d) Letter of Contract Performance
- 11.8.3 Final Cost Analysis-Insurance Transfer DPMC 25
- 11.8.4 This Submission Checklist

11.9 Final Payment

11.9.1 Contractors Final Payment

11.9.2 A/E Invoice and Close-Out Forms for Final Payment

11.10 Final Performance Evaluation of the A/E and the Contractors

11.11 Ensure Issuance of a “Certificate of Occupancy or Approval”

11.12 Submission Forms

Figure 11.2 Project Close-Out Documentation List DPMC 20A

Figure 11.3-a Certificate of Substantial Completion DPMC 20D

Figure 11.3-b Final Acceptance of Consultant Contract DPMC 20C

Figure 11.5 Request for Contract Transition Close-Out DPMC 20X

Figure 11.7 Final Contract Acceptance Form DPMC 20

Figure 11.8.3-a Final Cost Analysis

Figure 11.8.3-b Insurance Transfer Form DPMC 25

Figure 11.8.4 Submission Checklist

XV. EXHIBITS

The attached exhibits in this section will include a sample project schedule, and any supporting documentation to assist the Consultant in the design of the project such as maps, drawings, photographs, floor plans, studies, reports, etc.

END OF SCOPE OF WORK

February 7, 1997
Rev.: January 29, 2002

Responsible Group Code Table

The codes below are used in the schedule field "GRP" that identifies the group responsible for the activity. The table consists of groups in the Division of Property Management & Construction (DPMC), as well as groups outside of the DPMC that have responsibility for specific activities on a project that could delay the project if not completed in the time specified. For reporting purposes, the groups within the DPMC have been defined to the supervisory level of management (i.e., third level of management, the level below the Associate Director) to identify the "functional group" responsible for the activity.

<u>CODE</u>	<u>DESCRIPTION</u>	<u>REPORTS TO ASSOCIATE DIRECTOR OF:</u>
CM	Contract Management Group	Contract Management
CA	Client Agency	N/A
CSP	Consultant Selection and Prequalification Group	Technical Services
A/E	Architect/Engineer	N/A
PR	Plan Review Group	Technical Services
CP	Construction Procurement	Planning & Administration
CON	Construction Contractor	N/A
FM	Financial Management Group	Planning & Administration
OEU	Office of Energy and Utility Management	N/A
PD	Project Development Group	Planning & Administration

EXHIBIT 'A'

Activity ID	Description	Rspn	Weeks
<PROJ>			
Design			
CV3001	Schedule/Conduct Pre-design/Project Kick-Off Mtg.	CM	
CV3020	Prepare Program Phase Submittal	AE	
CV3021	Distribute Program Submittal for Review	CM	
CV3027	Prepare & Submit Project Cost Analysis (DPMC-38)	CM	
CV3022	Review & Approve Program Submittal	CA	
CV3023	Review & Approve Program Submittal	PR	
CV3024	Review & Approve Program Submittal	CM	
CV3025	Consolidate & Return Program Submittal Comments	CM	
CV3030	Prepare Schematic Phase Submittal	AE	
CV3031	Distribute Schematic Submittal for Review	CM	
CV3037	Prepare & Submit Project Cost Analysis (DPMC-38)	CM	
CV3032	Review & Approve Schematic Submittal	CA	
CV3033	Review & Approve Schematic Submittal	PR	
CV3034	Review & Approve Schematic Submittal	CM	
CV3035	Consolidate & Return Schematic Submittal Comment	CM	
CV3040	Prepare Design Development Phase Submittal	AE	
CV3041	Distribute D. D. Submittal for Review	CM	
CV3047	Prepare & Submit Project Cost Analysis (DPMC-38)	CM	
CV3042	Review & Approve Design Development Submittal	CA	
CV3043	Review & Approve Design Development Submittal	PR	
CV3044	Review & Approve Design Development Submittal	CM	
CV3045	Consolidate & Return D.D. Submittal Comments	CM	
CV3050	Prepare Final Design Phase Submittal	AE	
CV3051	Distribute Final Design Submittal for Review	CM	
CV3052	Review & Approve Final Design Submittal	CA	
CV3053	Review & Approve Final Design Submittal	PR	
CV3054	Review Final Design Submittal for Constructability	OCS	

Sheet 1 of 3

Bureau of Design & Construction Services
Routine Project

Exhibit "A"

DBCA - TEST

NOTE:
Refer to section "IV Project Schedule" of the
Scope of Work for contract phase durations.

© Primavera Systems, Inc.

Activity ID	Description	Reph	Weeks
CV2055	Review & Approve Final Design Submittal	CM	
CV2056	Consolidate & Return Final Design Comments	CM	
CV3060	Prepare & Submit Permit Application Documents	AE	
CV3068	Prepare & Submit Bidding Cost Analysis (DPMC-38)	CM	
Plan Review-Permit Acquisition			
CV4001	Review Constr. Documents & Secure UCC Permit	PR	
CV4010	Provide Funding for Construction Contracts	CA	
CV4020	Secure Bid Clearance	CM	
Advertise-Bid-Award			
CV5001	Advertise Project & Bid Construction Contracts	CP	
CV5010	Open Construction Bids	CP	
CV5011	Evaluate Bids & Prep. Recommendation for Award	CM	
CV5012	Evaluate Bids & Prep. Recommendation for Award	AE	
CV5014	Complete Recommendation for Award	CP	
CV5020	Award Construction Contracts/Issue NTP	CP	
Construction			
CV6000	Project Construction Start/Issue NTP	CM	
CV6001	Contract Start/Contract Work (25%) Complete	CON	
CV6002	Preconstruction Meeting	CM	
CV6003	Begin Preconstruction Submittals	CON	
CV6004	Longest Lead Procurement Item Ordered	CON	
CV6005	Lead Time for Longest Lead Procurement Item	CON	
CV6006	Prepare & Submit Shop Drawings	CON	
CV6007	Complete Construction Submittals	CON	
CV6011	Roughing Work Start	CON	
CV6012	Perform Roughing Work	CON	
CV6010	Contract Work (50%+) Complete	CON	
CV6013	Longest Lead Procurement Item Delivered	CON	
CV6020	Contract Work (75%) Complete	CON	

Sheet 2 of 3

Bureau of Design & Construction Services
Routine Project

Exhibit 'A'

DRCA - TEST

NOTE:
Refer to section "IV Project Schedule" of the
Scope of Work for contract phase durations.

© Primavera Systems, Inc.

Activity ID	Description	Respn	Weeks
CV6014	Roughing Work Complete	CON	
CV6021	Interior Finishes Start	CON	
CV6022	Install Interior Finishes	CON	
CV6030	Contract Work to Substantial Completion	CON	
CV6031	Substantial Completion Declared	CM	
CV6075	Complete Deferred Punch List/Seasonal Activities	CON	
CV6079	Project Construction Complete	CM	
CV6080	Close Out Construction Contracts	CM	
CV6089	Construction Contracts Complete	CM	
CV6090	Close Out A/E Contract	CM	
CV6092	Project Completion Declared	CM	

DBCA - TEST

Sheet 3 of 3

Bureau of Design & Construction Services
Routine Project

Exhibit 'A'

NOTE:
Refer to section "IV Project Schedule" of the
Scope of Work for contract phase durations.

© Primavera Systems, Inc.



**AERIAL VIEW OF WDC BUILDINGS PINNED
COTTAGES 2, 3, 4, 10
LEARNING CENTER, ADMINISTRATION & GEN-
ERAL SERVICES BUILDINGS**

EXHIBIT 'C'

M1537-00 Photographs of Existing Conditions



Cottage 10



Cottage 10 Basement-Likely Water Entry Location

M1537-00 Photographs of Existing Conditions



Cottage 2



Cottage 2 Basement

M1537-00 Photographs of Existing Conditions



Cottage 2 Existing Fire Alarm Panel in Basement




Learning Center

M1537-00 Photographs of Existing Conditions



Learning Center-Partial Sprinkler System Valve

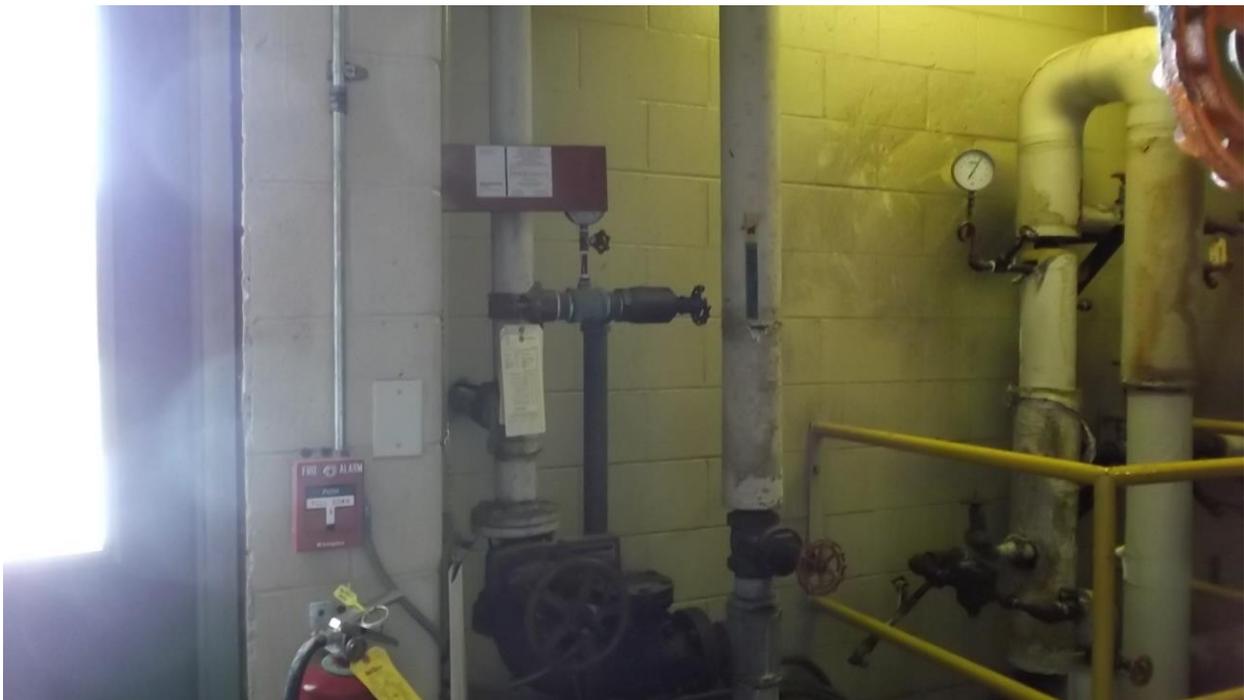

Learning Center- Existing Partial Sprinkler System Water Main

M1537-00 Photographs of Existing Conditions



Learning Center Electric and Fire Alarm Panels



Human Services Water Main Coming In Crawl Space To Partial Basement

M1537-00 Photographs of Existing Conditions



Administration Building-Basement Storage Areas fully Sprinklered



Administration Building-Basement Fire Water Main

M1537-00 Photographs of Existing Conditions



Administration Building-Basement Fire Water Main

Woodbine Developmental Center – Engineering Department

A. GENERAL SITE REGULATIONS

UNLESS OTHERWISE SPECIFIED IN THE SOW, THE FOLLOWING REPRESENTS THE GUIDELINES FOR WORK PERFORMED AT WOODBINE DEVELOPMENTAL CENTER.

1. Contractors and their Employees are authorized to be on grounds only during the performance of work related to the project.
2. The speed limit is 15 mph on grounds. Yield to all pedestrian traffic. Resident population is severely handicapped, some are blind, some are deaf; many do not possess good pedestrian skills.
3. Do not give anything to a resident. This includes food, money and cigarettes.
4. It is not permitted to photograph any resident.
5. Smoking is permitted in designated areas only. Matches and cigarette butts pose a life threatening danger to some of our residents and must be disposed in an appropriate receptacle.
6. Contractor will be responsible to police the construction area keeping it free of debris and litter.
7. Vehicles and operating equipment is to be off and secure whenever not in use. All tools and equipment are to be secured at the end of the work day. If kept on site, they must be stored within a fenced work staging area. WDC will not assume responsibility for any missing articles.
8. To minimize the disruption to unexcavated areas and enhance the protection of fragile underground utilities, ground mats are to be used if heavy equipment (cranes, tractor trailers, dumpsters) is expected to travel over or operate from unpaved areas.
9. Active construction, staging and equipment storage areas are to be fenced and secured (6 foot chain link preferred) at all times to prevent residents and employees from wandering inside.
10. Possession and/or consumption of alcoholic beverages or drugs are prohibited, by law, anywhere on State property.
11. Please Note: As available, prints of the site's utilities may have been provided by the facility. Understand that the prints are general and that we have encountered situations where they are not accurate. Contractor should determine the actual location of any utility within the construction zone.

B. HOURS OF WORK

1. Work will occur Monday through Friday only. Any work on Saturday, Sunday, or state Holiday must be approved by the project coordinator and the WDC Engineering Office. A two day (48 hour) notice is required.
2. Project work will not begin before 7:30am.
3. WDC Engineering Office is to be notified whenever project work is to occur beyond 4:30pm. A two day (48 hour) notice is required. Approval for ongoing work which is required to be completed that day should be sought by project manager/site foreman as soon as he becomes aware of the need. Facility will work with project manager to accommodate unanticipated needs.
4. No work will occur past dusk without 48 hours notice and approval of the WDC Engineering Office.
5. The facility requires a minimum of 48 hours notice for any contractor operation such as large material deliveries, power tie-ins, etc, that will impact or potentially disrupt facility operations.

EXHIBIT 'E'